



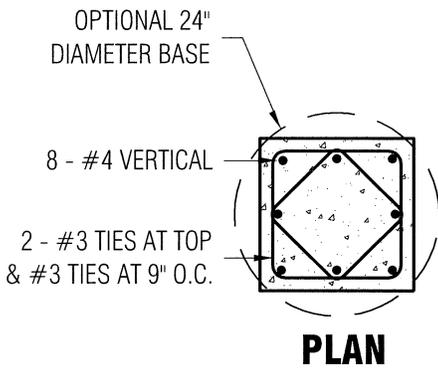

COOPER LIGHTING FIXTURE TYPE UTR TRADITIONAIRE (OR APPROVED EQUAL), HID LUMINAIRE, 70W HPS LAMP, 120V, TYPE V DISTRIBUTION, UL LISTED FOR WET LOCATION

COOPER LIGHTING LIGHT POLE CATALOG No. RSA4T08AD 4" DIAMETER, DIE-CAST ALUMINUM, BLACK ANODIZED FINISH (OR APPROVED EQUAL)


FLUSH HANDHOLE IN BASE OF POLE WITH TAMPER RESISTANT SCREWS  
 WEATHERPROOF, CFGI RECEPTACLE  
 PROVIDE GROUND LUG  
 HEAVY WALL ALUMINUM BASE COVER  
 GROUT AS REQUIRED

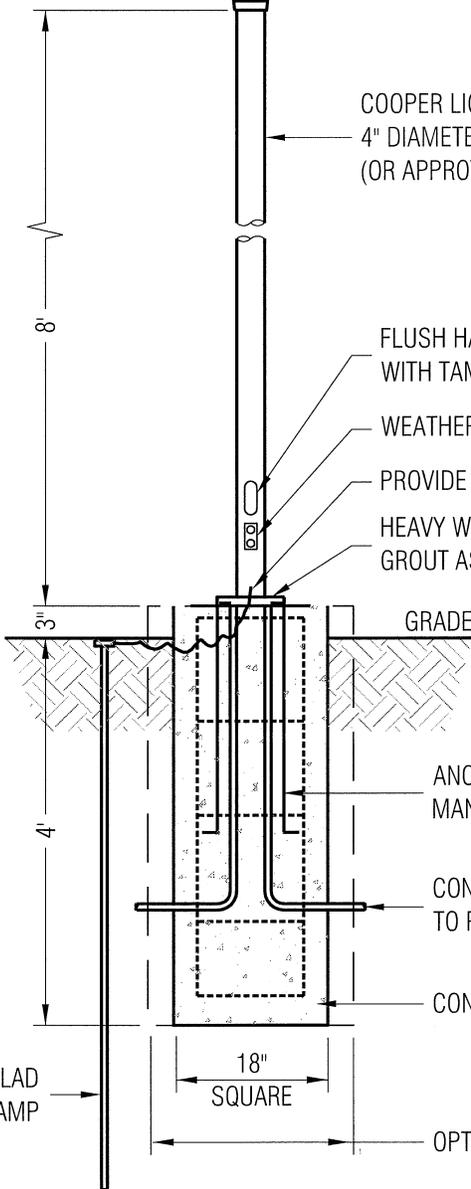

5/8" DIA. X 8'-0" L, COPPER CLAD GROUND ROD WITH CLAMP

ANCHOR BOLTS AND SPACING PER POLE MANUFACTURER'S RECOMMENDATION  
 CONDUIT(S) TO OTHER POLES OR HOMERUN TO PANEL, MIN. 18" BELOW GRADE  
 CONCRETE BASE 2500 PSI MIN. AFTER 28 DAYS  
 OPTIONAL 24" DIAMETER BASE

**NOTE:**  
 CONTRACTOR SHALL SUBMIT A FOOTCANDLE POINT TO POINT DIAGRAM FOR APPROVAL PRIOR TO ORDERING. SUBMITTAL SHALL USE LIGHT POLE MANUFACTURER'S PHOTOMETRIC DATA

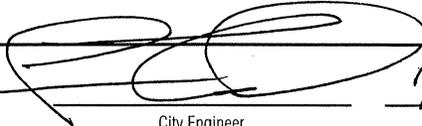Approved:  1/4/10  
 City Engineer Date



REVISION	
Description	Date

<b>ENGINEERING DIVISION</b>	
<b>PARK ELECTROLIER</b>	<b>SL-5</b>