


**PLAN**

**NOTES:**

1. INLET BASE TO BE POURED AGAINST UNDISTURBED EARTH. SIDES MAY BE FORMED OR MAY BE POURED AGAINST UNDISTURBED EARTH.
2. NO CONCRETE SHALL BE POURED PRIOR TO CHECKING OF FORMS AND STEEL PLACEMENT BY THE ENGINEER.
3. ALL REINFORCING STEEL SHALL HAVE A MINIMUM CLEAR DISTANCE OF 3" AND SHALL BE CONTINUOUS AROUND CORNERS OR SHALL BE LAPPED AT LEAST 15" AFTER THE BEND. THE MINIMUM OVERLAP FOR A LAPPED SPLICE SHALL BE 15".
4. INDICATES OPTIONAL CONSTRUCTION JOINT.

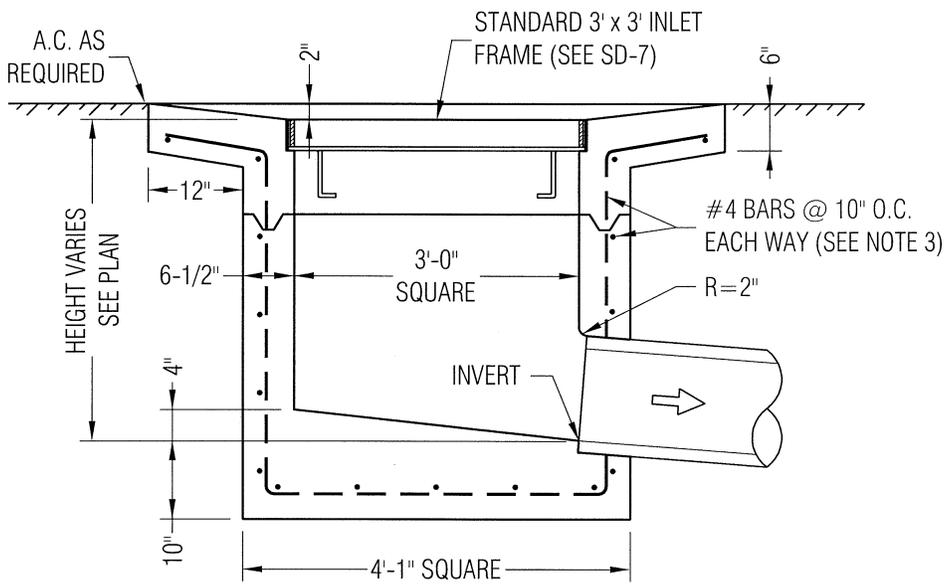

**SECTION A-A**

Approved: 1/4/10  
 City Engineer Date



REVISION	
Description	Date

ENGINEERING DIVISION	
<b>3' x 3' STORM DRAIN INLET</b>	<b>SD-6</b>