


City of Los Altos  
Parking Plaza -Driveway Approach Inventory  
3/5/15


Driveway Approach No.	ADA compliance	Note
7	No	Cross Slope exceeds maximum.
8	No	Cross Slope exceeds maximum.
9	No	Cross Slope exceeds maximum.
10	No	Cross Slope exceeds maximum.
61	No	Cross Slope exceeds maximum. Storm Drain inlet relocation required
62	No	Cross Slope exceeds maximum.
63	No	Cross Slope exceeds maximum.



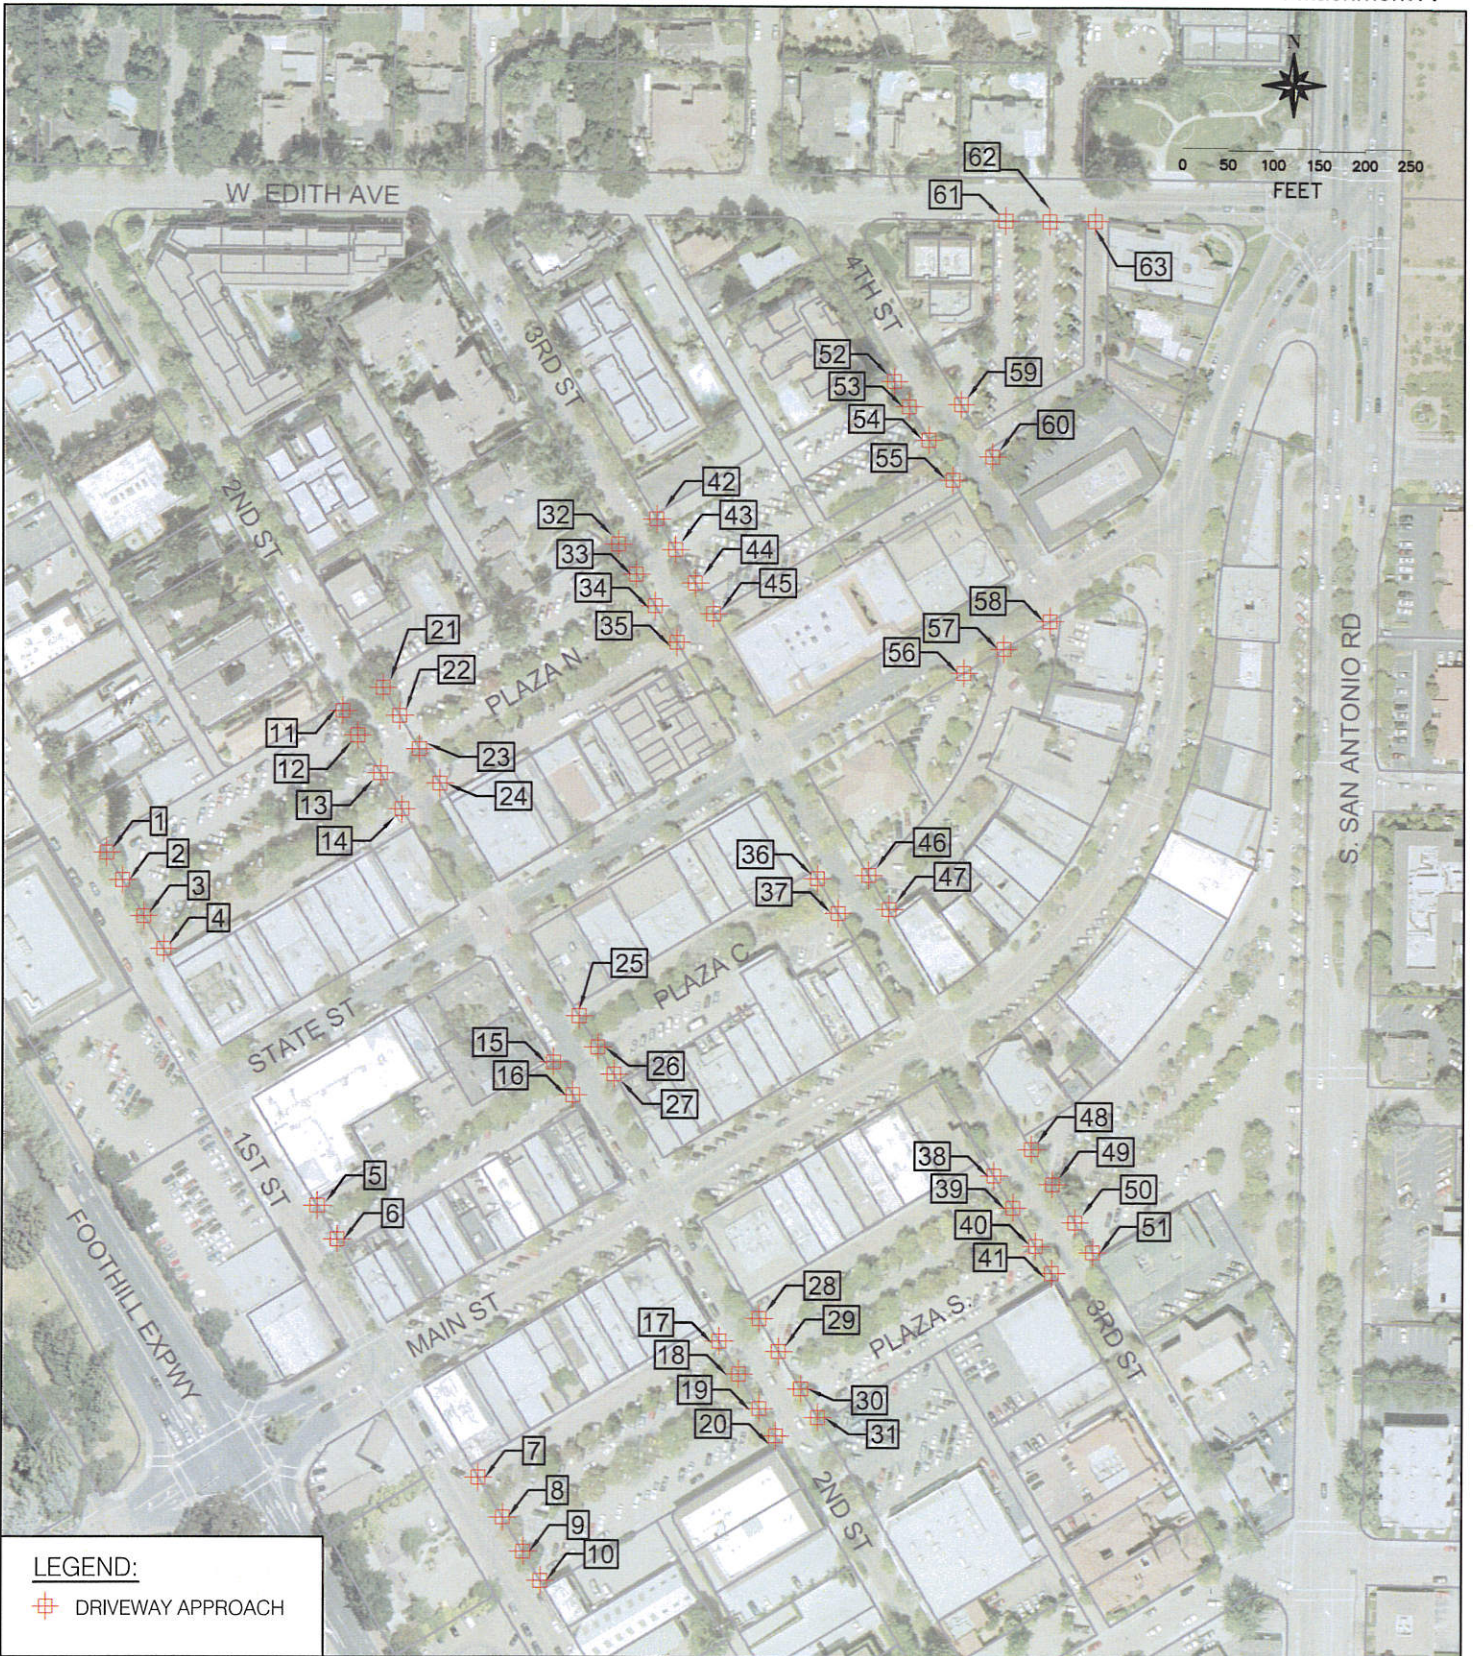

**LEGEND:**

 DRIVEWAY APPROACH



**REVISION**

Description	Date

**ENGINEERING DIVISION**

**DOWNTOWN PARKING LOT  
DRIVEWAY APPROACH  
INVENTORY**

DRAWN	VW
CHECKED	VC
APPROVED	VC
DATE	3/4/2015
SCALE	1" = 200'
DWG. NO.	