

SITE ID: CRAN RSFR LOSAO 12

356 BLUE OAK LN SITE ADDRESS:

LOS ALTOS, CA 94022

PM#: TBD

SITE TYPE: PG&E POLE #TBD

POLE OWNER: PG&E

FA LOCATION: 14816600

USID: 198302

SITE INFORMATION

AT#T MOBILITY APPLICANT: 5001 EXECUTIVE PARKWAY SAN RAMON, CA 94583

> SURESITE 36 EXECUTIVE PARK, SUITE 210

IRVINE, CA 92614

AGENT:

COUNTY:

ADJCT TO 167-34-088 SITE ADDRESS: 356 BLUE OAK LN

LOS ALTOS, CA 94022

37° 23' 14.83" N (37.387453) NAD 83 LATITUDE:

SANTA CLARA

CODE COMPLIANCE

CONSTRUCTION WORKS & MATERIALS MUST COMPLY WITH ALL APPLICABLE NATIONAL, STATE

\$ LOCAL CODES AS ADOPTED BY LOCAL JURISDICTION, INCLUDING BUT NOT LIMITED TO:

THIS FACILITY IS UNMANNED \$ NOT FOR HUMAN HABITATION. HANDICAPPED ACCESS \$

1. 2016 CALIFORNIA ADMINISTRATIVE CODE (INCL. TITLES 24 \$ 25)

2. 2016 CALIFORNIA BUILDING CODE

3. 2016 CALIFORNIA ELECTRICAL CODE

4. 2016 CALIFORNIA MECHANICAL CODE

5. 2016 CALIFORNIA PLUMBING CODE

HANDICAP REQUIREMENTS

6. 2016 CALIFORNIA FIRE CODE

7. LOCAL BUILDING CODES


9. ANSI/EIA-TIA-222-G

8. CITY/COUNTY ORDINANCES

LONGITUDE: 122° 07' 30,42" W (-122,125117) NAD 83

GROUND ELEVATION: ±140.6' AMSL ZONING: PUBLIC ROW ZONING JURISDICTION: CITY OF LOS ALTOS

VICINITY MAP

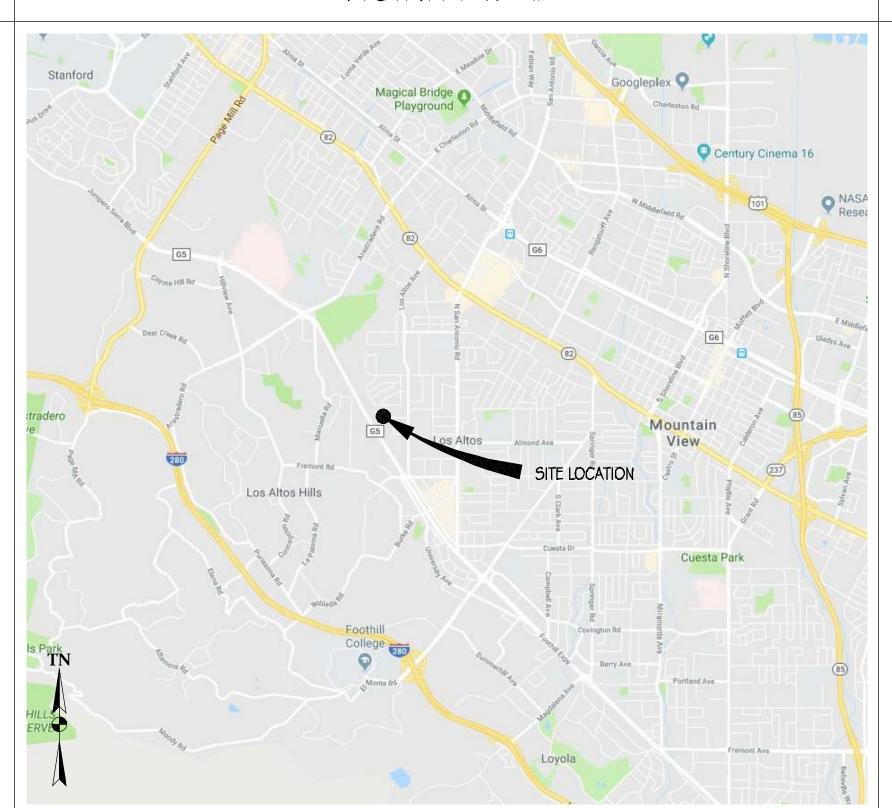

DRIVING DIRECTIONS

DIRECTIONS FROM AT&T WIRELESS WALNUT CREEK OFFICE

500 I EXECUTIVE PARKWAY, SAN RAMON, CA 94583

356 BLUE OAK LN, LO5 ALTO5, CA 94022

1.	HEAD NORTHEAST ON BISHOP DR TOWARD SUNSET DR	256	FT
2.	TURN RIGHT ONTO SUNSET DR	0.1	М
3.	USE THE RIGHT 2 LANE TO TURN RIGHT ONTO BOLLINGER CANYON RD	0.3	М
4.	USE THE RIGHT LANE TO MERGE ONTO 1-680 S VIA THE RAMP TO SAN JOSE	0.3	М
5.	MERGE ONTO 1-680 5	3.9	М
6.	CONTINUE STRAIGHT TO STAY ON 1-680 5	17.5	M
7.	TAKE EXIT 12 FOR MISSION BLVD/STATE ROUTE 262 TOWARD 1-880	0.2	М
8,	KEEP RIGHT AT THE FORK MERGE ONTO CA-262 S/MISSION BLVD	0.3	М
9.	MERGE ONTO CA-262 S/MISSION BLVD	0.6	М
10.	USE THE LEFT 2 LANES TO TAKE THE EXIT TOWARD I-880 S/SAN JOSE	0.9	M
11,	MERGE ONTO 1-880 5	3.1	M
12,	USE THE RIGHT 2 LANES TO TAKE THE CA-237 W EXIT TOWARD MTN VIEW	0.9	М
13.	KEEP LEFT TO CONTNUE ON CA-237 W/ SOUTHBAY PWY	0.5	М
14.	TURN RIGHT ONTO EL CAMINO REAL	1.4	М
15.	USE THE LEFT 2 LANES TO TURN LEFT ONTO EL MONTE AVE	0.4	М
16,	TURN RIGHT ONTO N EL MONTE AVE	0,1	M
۱7,	TURN RIGHT ONTO ALMOND AVE	0.9	М
۱ø,	TURN LEFT ONTO N SAN ANTONIO RD	0.1	М
19.	TURN RIGHT AT THE 1ST CROSS STREET ONTO MT HAMILTON AVE	0.4	М

20. TURN RIGHT ONTO LOS ALTOS AVE

21. TURN LEFT ONTO YERBA BUENA AVE

22. TURN RIGHT ONTO BLUE OAK LN

REQUIREMENTS ARE NOT REQUIRED IN ACCORDANCE WITH CALIFORNIA STATE ADMINISTRATIVE CODE, TITLE 24 PART 2, SECTION 1105B.3.4.2, EXCEPTION 1

0.4 MI

0.2 MI

END AT: 356 BLUE OAK LN, LOS ALTOS, CA 94022

ESTIMATED TIME: I HR 18 MINS ESTIMATED DISTANCE: 41 MI

PROJECT TEAM

2033 GATEWAY PLACE, 6TH FLOOR SAN JOSE, CA 95110 (949) 278-2962 L.MEINERS@SURE-SITE.COM

PROJECT MANAGERS: CHRIS JOHNSON 6140 STONERIDGE MALL RD, SUITE 350

PLEASANTON, CA 94588 (408) 796-8443 CHRISTOPHER.JOHNSON@ERICSSON.COM

ARCHITECT/ENGINEER OF RECORD: BRET McCOMB

PRECISION DESIGN & DRAFTING, INC 11768 ATWOOD ROAD, SUITE #20 AUBURN, CA 95603 (530) 823-6546 BRET@PDND.COM

CONSTRUCTION MANAGER: DELBERT BUTCHER **ERICSSON** 6140 STONERIDGE MALL ROAD, SUITE 350 PLEASANTON, CA 94588 (720) 317-7282

At all services & grounding trenches, provide

NATIONWIDE UNDERGROUND SERVICE ALERT

"CALL BEFORE YOU DIG"

811/800-227-2600

" WARNING" tape at 12" below grade.

PROJECT DESCRIPTION

ANTENNAS & ASSOCIATED EQUIPMENT ON AN (E) PG&E UTILITY POLE IN THE PUBLIC RIGHT OF WAY.

SCOPE OF WORK:

- COMPLIANT STANDOFF BRACKET \$ CONSISTS OF (1) ELECTRICAL METER, (1) LOAD CENTER/AC DISCONNECT, (1) CONCEALMENT BOX CONTAINING (1) RRUS-4415 \$ (1) RRUS-11 W/ PSU UNITS, (2) DIPLEXERS, \$ (1) KMW FX-OM2L10H2-06T CYLINDRICAL ANTENNA.
- 4. FIBER CONNECTION TO BE SECURE UNDER SEPARATE ENCROACHMENT PERMIT.

SHEET NO:

TITLE SHEET

SITE PLAN

EQUIPMENT PLAN & ANTENNA PLANS

ELEVATIONS

DETAILS

DETAILS

SINGLE-LINE DIAGRAM \$ DETAILS

THIS IS AN UNMANNED TELECOMMUNICATIONS FACILITY FOR AT&T WIRELESS CONSISTING OF THE INSTALLATION & OPERATION OF

- I. INSTALL (N) TELECOMMUNICATIONS EQUIPMENT BOXES ON AN (E) PG&E UTILITY POLE. EQUIPMENT IS TO BE INSTALLED ON GO95
- 2. ALL EQUIPMENT, EQUIPMENT MOUNTING, CONDUITS, AND APPURTENANCES TO BE PAINTED TO MEET JURISDICTION APPROVAL
- 3. UTILITY LINES BETWEEN (E) POINT OF CONNECTION \$ POLE TO BE UNDERGROUND AND/OR OVERHEAD.

DRAWING INDEX


GENERAL NOTES, LEGEND, \$ ABBREVIATIONS

ELEVATIONS


GROUNDING DIAGRAMS

ADMINISTRATIVE REQUIREMENTS

CONTRACTOR SHALL VERIFY ALL PLANS \$ (E) DIMENSIONS \$ CONDITIONS ON THE JOB SITE \$ SHALL IMMEDIATELY NOTIFY THE ENGINEER IN WRITING OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK OR BE RESPONSIBLE FOR SAME IF USING 11" X 17" PLOT, DRAWINGS WILL BE HALF SCALE

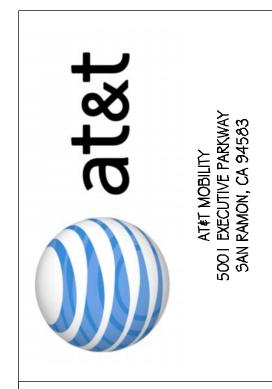





CRAN RSFR LOSAO 12

356 BLUE OAK LN LO5 ALTO5, CA 94022

	ISSUE :	STATUS
\triangle	DATE	DESCRIPTION

	06/19/18	3	CD 90%	
	07/25/19	9	CD 100%	
DRAWN	BY:	(). REDDISH	
CHECK	ED BY:	1	. DICARLO	
APPRO	VED BY:	E	В. МсСОМВ	
, and the second				

TITLE SHEET

SHEET TITLE:

SHEET NUMBER

GENERAL CONSTRUCTION NOTES

- 1. PLANS ARE INTENDED TO BE DIAGRAMMATIC OUTLINE ONLY, UNLESS NOTED OTHERWISE. THE WORK SHALL INCLUDE FURNISHING MATERIALS, EQUIPMENT, APPURTENANCES AND LABOR NECESSARY TO COMPLETE ALL INSTALLATIONS AS INDICATED ON THE DRAWINGS.
- 2. THE CONTRACTOR SHALL OBTAIN, IN WRITING, AUTHORIZATION TO PROCEED BEFORE STARTING WORK ON ANY ITEM NOT CLEARLY DEFINED OR IDENTIFIED BY THE CONTRACT DOCUMENTS.
- 3. CONTRACTOR SHALL CONTACT USA (UNDERGROUND SERVICE ALERT) AT (800) 227-2600, FOR UTILITY LOCATIONS, 48 HOURS BEFORE PROCEEDING WITH ANY EXCAVATION, SITE WORK OR CONSTRUCTION.
- 4. THE CONTRACTOR SHALL INSTALL ALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH MANUFACTURES RECOMMENDATIONS UNLESS SPECIFICALLY INDICATED OTHERWISE, OR WHERE LOCAL CODES OR REGULATIONS TAKE PRECEDENCE.
- 5. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE CBC/UBC'S REQUIREMENTS REGARDING EARTHQUAKE RESISTANCE, FOR, BUT NOT LIMITED TO, PIPING, FIXTURES, CEILING GRID, INTERIOR PARTITIONS, AND MECHANICAL EQUIPMENT. ALL WORK MUST COMPLY WITH LOCAL EARTHQUAKE CODES AND REGULATIONS.
- 6. REPRESENTATIONS OF TRUE NORTH, OTHER THAN THOSE FOUND ON THE PLOT OF SURVEY DRAWINGS, SHALL NOT BE USED TO IDENTIFY OR ESTABLISH BEARING OF TRUE NORTH AT THE SITE, THE CONTRACTOR SHALL RELY SOLELY ON THE PLOT OF SURVEY DRAWING AND ANY SURVEYORS MARKINGS AT THE SITE FOR THE ESTABLISHMENT OF TRUE NORTH, AND SHALL NOTIFY THE ARCHITECT/ENGINEER PRIOR TO PROCEEDING WITH THE WORK IS ANY DISCREPANCY IS FOUND BETWEEN THE CARIOUS ELEMENTS OF THE WORKING DRAWINGS AND THE TRUE NORTH ORIENTATION AS DEPICTED ON THE CIVIL
- 7. THE BUILDING DEPARTMENT ISSUING THE PERMITS SHALL BE NOTIFIED AT LEAST TWO WORKING DAYS PRIOR TO THE COMMENCEMENT OF WORK, OR AS OTHERWISE STIPULATED BY THE CODE ENFORCEMENT
- 8. DO NOT EXCAVATE OR DISTURB BEYOND THE PROPERTY LINES OR LEASE LINES, UNLESS OTHERWISE NOTED.
- 9. ALL EXISTING UTILITIES, FACILITIES, CONDITIONS, AND THEIR DIMENSIONS SHOWN ON THE PLAN HAVE BEEN PLOTTED FROM AVAILABLE RECORDS, THE ARCHITECT/ENGINEER AND THE OWNER ASSUME NO RESPONSIBILITY WHATSOEVER AS TO THE SUFFICIENCY OR THE ACCURACY OF THE INFORMATION SHOWN ON THE PLANS, OR THE MANNER OF THEIR REMOVAL OR ADJUSTMENT. CONTRACTORS SHALL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL EXISTING UTILITIES AND FACILITIES PRIOR TO START OF CONSTRUCTION, CONTRACTORS SHALL ALSO OBTAIN FROM EACH UTILITY COMPANY DETAILED INFORMATION RELATIVE TO WORKING SCHEDULES AND METHODS OF REMOVING OR ADJUSTING EXISTING UTILITIES.
- 10. CONTRACTOR SHALL VERIFY ALL EXISTING UTILITIES, BOTH HORIZONTAL AND VERTICALLY, PRIOR TO THE START OF CONSTRUCTION, ANY DISCREPANCIES OR DOUBTS AS TO THE INTERPRETATION OF PLANS SHOULD BE IMMEDIATELY REPORTED TO THE ARCHITECT. ENGINEER FOR RESOLUTION AND INSTRUCTION. AND NO FURTHER WORK SHALL BE PREFORMED UNTIL THE DISCREPANCY IS CHECKED AND CORRECTED
- 11. ALL NEW AND EXISTING UTILITY STRUCTURES ON SITE AND IN AREAS TO BE DISTURBED BY CONSTRUCTION SHALL BE ADJUSTED TO FINISH ELEVATIONS PRIOR TO FINAL INSPECTION OF WORK.
- 12. ANY DRAIN AND/OR FIELD TILE ENCOUNTERED/ DISRUPTED DURING CONSTRUCTION SHALL BE RETURNED TO ITS ORIGINAL CONDITION PRIOR TO COMPLETION OF WORK. SIZE, LOCATION AND TYPE OF ANY UNDERGROUND UTILITIES OR IMPROVEMENTS SHALL BE ACCURATELY NOTED AND PLACED ON "AS-BUILT" DRAWINGS BY GENERAL CONTRACTOR, AND ISSUED TO THE ARCHITECT/ ENGINEER AT COMPLETION OF
- 13. ALL TEMPORARY EXCAVATIONS FOR THE INSTALLATION OF FOUNDATIONS, UTILITIES, ETC, SHALL BE PROPERLY LAID BACK OR BRACED IN ACCORDANCE WITH CORRECT OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (QSHA) REQUIREMENTS.
- 14. INCLUDE MISC ITEMS PER AT \$\pi\$ WIRELESS SPECIFICATIONS.
- 16, FONDATED RF WAC MARNING SIGNAGE SHALL FACE OUT TO STREET WHEN PLACED IN FRONT OF OR NEAR A WINDOW. SIGNAGE SHALL FACE TOWARD THE BUILDING IF THERE IS NO WINDOW.
- 17. ALL EQUIPMENT, INCLUDING ANTENNAS, MOUNTING/STANDOFF BRACKETS, POLE EXTENSIONS, CONDUIT, METER, AND RADIOS SHALL BE PAINTED 'MESA BROWN' USING A DURABLE OUTDOOR PAINT.

GROUT OR PLASTER

- 18. CABLING SHALL BE MESA BROWN IN COLOR AND SHALL BE INSTALLED IN A TIDY MANNER WITHOUT EXCESS CABLE LOOPS, \$ SHALL BE HIDDEN FROM VIEW TO THE MAXIMUM EXTENT POSSIBLE.
- 19. SUPPORT EQUIPMENT (E.G. METERS, DISCONNECT SWITCH, ETC) TO BE CLUSTERED VERTICALLY AS CLOSE AS TECHNICALLY FEASIBLE ON POLE.

GENERAL NOTES FOR EXISTING CELL SITES

- PRIOR TO THE SUBMISSION OF BIDS, THE BIDDING CONTRACTOR SHALL VISIT THE CELL SITE TO FAMILIARIZE WITH THE EXISTING CONDITIONS AND TO CONFIRM THAT THE WORK CAN BE ACCOMPLISHED AS SHOWN ON THE CONSTRUCTION DRAWINGS. ANY DISCREPANCY FOUND SHALL BE BROUGHT TO THE ATTENTION OF CONTRACTOR.
- CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS PRIOR TO COMMENCING ANY WORK. ALL DIMENSIONS OF EXISTING CONSTRUCTION SHOWN ON THE DRAWINGS MUST BE VERIFIED. CONTRACTOR SHALL NOTIFY THE CONTRACTOR OF ANY DISCREPANCIES PRIOR TO ORDERING MATERIAL OR PROCEEDING WITH CONSTRUCTION.
- THE EXISTING CELL SITE IS IN FULL COMMERCIAL OPERATION. ANY CONSTRUCTION WORK BY CONTRACTOR SHALL NOT DISRUPT THE EXISTING NORMAL OPERATION. ANY WORK ON EXISTING EQUIPMENT MUST BE COORDINATED WITH CONTRACTOR. ALSO, WORK SHOULD BE SCHEDULED FOR AN APPROPRIATE MAINTENANCE WINDOW USUALLY IN LOW TRAFFIC PERIODS AFTER MIDNIGHT.
- SINCE THE CELL SITE IS ACTIVE, ALL SAPETY PRECAUTIONS MUST BE TAKEN WHEN WORKING AROUND HIGH LEVELS OF ELECTROMAGNETIC RADIATION. EQUIPMENT SHOULD BE SHUTDOWN PRIOR TO PERFORMING ANY WORK THAT COULD EXPOSE THE WORKERS TO DANGER, PERSONAL RF EXPOSURE MONITORS ARE ADVISED TO BE WORN TO ALERT OF ANY DANGEROUS EXPOSURE LEVELS.
- CONTRACTOR SHALL DETERMINE ACTUAL ROUTING OF CONDUIT, POWER AND TI CABLES, GROUNDING CABLES AS SHOWN ON THE POWER AND GROUNDING PLAN DRAWING. CONTRACTOR SHALL UTILIZE EXISTING TRAYS AND/OR SHALL ADD NEW TRAYS AS NECESSARY, CONTRACTOR SHALL CONFIRM THE ACTUAL ROUTING WITH THE CONTRACTOR.
- CONTRACTOR SHALL LEGALLY AND PROPERLY DISPOSE OF ALL SCRAP MATERIALS SUCH AS COAXIAL CABLES AND OTHER ITEMS REMOVED FROM THE EXISTING FACILITY. ANTENNAS REMOVED SHALL BE RETURNED TO THE OWNER'S DESIGNATED LOCATION.

APPLICABLE CODES, REGULATIONS, AND STANDARDS

- CONTRACTORS WORK SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE, AND LOCAL CODES AS ADOPTED BY THE LOCAL AUTHORITY HAVING JURISDICTION (AHJ) FOR THE LOCATION.
- THE EDITION OF THE AHJ ADOPTED CODES AND STANDARDS IN EFFECT ON THE DATE OF CONTRACT AWARD SHALL GOVERN THE DESIGN.
- CONTRACTORS WORK SHALL COMPLY WITH THE LATEST EDITION OF THE FOLLOWING STANDARDS:
 - -AMERICAN CONCRETE INSTITUTE (ACI) 318, BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE -AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC), MANUAL OF STEEL CONSTRUCTION, ASD, NINTH EDITION -TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA) 222-F. STRUCTURAL STANDARD FOR STRUCTURAL ANTENNA TOWER AND ANTENNA SUPPORTING STRUCTURES -INSTITUTION FOR ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE) 81, GUIDE FOR MEASURING EARTH RESISTIVITY, GROUND IMPEDANCE, AND EARTH SURFACE POTENTIALS OF A GROUND SYSTEM IEEE (1999) RECOMMENDED PRACTICE FOR POWERING AND GROUNDING OF ELECTRICAL EQUIPMENT
 - -IEEE CG2.41, RECOMMENDED PRACTICES ON SURGE VOLTAGES IN LOW VOLTAGE AC POWER CIRCUITS (FOR LOCATION CATEGORY "C3" AND "HIGH SYSTEM EXPOSURE")
- TIA 607 COMMERCIAL BUILDING GROUNDING AND BONDING REQUIREMENTS FOR TELECOMMUNICATIONS AND TELCORDIA GR-63 NETWORK EQUIPMENT-BUILDING SYSTEM (NEBS): PHYSICAL PROTECTION TELCORDIA GR-347 CENTRAL OFFICE POWER WIRING TELCORDIA GR-1275 GENERAL INSTALLATION REQUIREMENTS
- ANY AND ALL OTHER LOCAL \$ STATE LAWS AND REGULATIONS

TELCORDIA GR-1503 COAXIAL CABLE CONNECTIONS

FOR ANY CONFLICTS BETWEEN SECTIONS OF LISTED CODES AND STANDARDS REGARDING MATERIAL, METHODS OF CONSTRUCTION, OR OTHER REQUIREMENTS, THE MOST RESTRICTIVE SHALL GOVERN. WHERE THERE IS CONFLICT BETWEEN A GENERAL REQUIREMENT AND SPECIFIC REQUIREMENT, THE SPECIFIC REQUIREMENT SHALL GOVERN.

5/8" X 10'-0" ,CU, GND ROD IN TEST WELL 18" MIN.

GENERAL TRENCHING NOTES

- MAINTAIN 40" MINIMUM COVER FOR ALL ELECTRICAL CONDUITS.
- MAINTAIN 30" MINIMUM COVER FOR ALL TELECOMMUNICATIONS CONDUITS.
- MINIMUM I " SAND SHADING BELOW CONDUITS, AND 6" COVERING ON TOP OF CONDUITS REQUIRED. ALL ELECTRICAL CONDUITS FROM POWER COMPANY FROM ANY POLE, TRANSFORMER OR OTHER LOCATIONS WILL BE SLURRY BACKFILLED.
- IN STREET SLURRY TO GRADE AND MILL DOWN 1-1/2" FOR AC CAP.
- IN DIRT SLURRY 18" FROM GRADE AND FILL 95% COMPACTION NATIVE SOIL FOR BALANCE
- WARNING TAPE TO BE PLACED IN TRENCH 12" ABOVE ALL CONDUITS AND #18 WARNING TAPE ABOVE RING.

GENERAL GROUNDING NOTES

- 5/8" x 10' ROD, CAD WELD BELOW GRADE
- GROUND TESTED AT 5 OHMS OR LESS.
- #2 GROUND AND BOND WIRE. GROUND 2' MIN FROM POLE,
- PLACE 3 #10 GA WIRES FROM TESCO BREAKER TO PBMD OR STRONG BOX.
- WOOD MOULDING, STAPLED EVERY 3' AND AT EACH END, UNLESS OTHERWISE NOTED.

GENERAL CONDUIT NOTES

- ALL CONDUITS WILL BE MANDRELED AND EQUIPPED WITH 3/8" PULL ROPE.
- SCHEDULE 40 CONDUIT FOR UNDERGROUND USE.
- SCHEDULE 80 CONDUIT FOR RISER USE.
- 2" GALVANIZED STEEL CONDUIT FOR ANY CONDUIT UNDER 3", STUB UP 10" THEN CONVERT TO SCHEDULE 80.
- CONVERT 4" CONDUIT TO 3" AT BASE OF POLE.
- CONTRACTOR TO STUB UP POLE 10" w/ 3" POWER CONDUIT. POWER COMPANY TO CONVERT FROM 3" STUB SCHEDULE 80 TO 2" SCHEDULE 80 FROM TOP OF STUB UP.

TYPICAL R.O.W. POLE CONSTRUCTION NOTES

- CABLE NOT TO IMPEDE 15" CLEAR SPACE OFF POLE FACE.
- ALL CLIMB STEPS NEXT TO CONDUIT SHALL HAVE EXTENDED STEPS.
- NO BOLT THREADS TO PROTRUDE MORE THAN 1-1/2"
- ALL HOLES IN POLE LEFT FROM REARRANGEMENT OF CLIMBERS TO BE FILLED.
- 90° SHORT SWEEPS UNDER ANTENNA ARM, ALL CABLES MUST TRANSITION ON THE INSIDE OR BOTTOM OF THE ARM (NO CABLE ON TOP OF ARM).
- USE 90° CONNECTOR AT CABLE CONNECTION FOR OMNI DOWN ANTENNAS.
- USE CABLE CLAMPS TO SECURE CAB;LE TO ARMS, PLACE 2" T-MOBILE CABLE I.D. TAGS ON BOTH SIDES OF ARMS.
- USE 1/2" DIA. CABLE ON ANTENNAS UNLESS OTHERWISE SPECIFIED.
- FILL VOID AROUND CABLES AT CONDUIT OPENING WITH FOAM SEALANT TO PREVENT WATER INTRUSION.

ABBREVIATIONS

٨	ANADEDE	ur	LIEIGUT
A AB	AMPERE ANCHOR BOLT	HT ICGB	HEIGHT ISOLATED COPPER GROUND BUSS
ABV	ABOVE	IN, (")	INCH(ES)
ACCA	ANTENNA CABLE COVER ASSEMBLY	INT	INTERIOR
ADD'L	ADDITIONAL ADDITIONAL	LB, (#)	POUND(5)
AFF AFC	ABOVE FINISHED FLOOR	LAG	LAG BOLTS
afg aic	ABOVE FINISHED GRADE AMPERE INTERRUPTING CAPACITY	LF LTH	LINEAR FEET (FOOT) LENGTH
ALUM	ALUMINUM	L111 L	LONG(ITUDINAL)
ALT	ALTERNATE	ips	LOW PRESSURE SODIUM
ant	ANTENNA	MAS	MASONRY
APPROX	APPROXIMATE(LY)	MAX	MAXIMUM
ARCH AT	ARCHITECT(URAL) AMPERE TRIP	MB	MACHINE BOLT
AWG	AMERICAN WIRE GAUGE	MECH	MECHANICAL
BATT	BATTERY	MFR MIN	MANUFACTURER MINIMUM
BD	BOARD	MISC	MISCELLANEOUS
BLDG	BUILDING	MLO	MAIN LUGS ONLY
Blk, Blkg	BLOCK BLOCKING	MTD	MOUNTED
BM	BEAM	MTG	MOUNTING
BN	BOUNDARY NAILING	MTL MTS	METAL MANUAL TRANSFER SWITCH
BR	BRANCH	N.	NEUTRAL
BRKR	BREAKER	(N)	NEW
BTCW	BARE TINNED COPPER WIRE	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOC.
BTS BOF	BASE TRANSMISSION SYSTEM BOTTOM OF FOOTING	NO, (#)	NUMBER
B/U	BACK-UP CABINET	NTS	NOT TO SCALE OVERHEAD
č	CONDUIT	OH OC	ON CENTER
CAB	CABINET	OPNG	OPENING .
CANT	CANTILEVER(ED)	P	POLE
CB	CIRCUIT BREAKER	P/C	PRECAST CONCRETE
CIP CKT	CAST IN PLACE CIRCUIT	PCS	PERSONAL COMMUNICATION SERVICES
CLG	CEILING	PH P LY	PHASE PLYWOOD
CLR	CLEAR	rly PNLBD	PANELBOARD
COL	COLUMN	PPC	POWER PROTECTION CABINET
CONC	CONCRETE	PRC	PRIMARY RADIO CABINET
CONN	CONNECTION(OR)	PRI_	PRIMARY
CONST CONT	CONSTRUCTION CONTINUOUS	PSF	POUNDS PER SQUARE FOOT
d	PENNY (NAILS)	P 5I P T	POUNDS PER SQUARE INCH PRESSURE TREATED
ĎBL	DOUBLE	PWR	POWER (CABINET)
DEM	DEMAND	QTY	QUANTITY
DEPT	DEPARTMENT	RAD, (R)	RADIUS
DF DIA	DOUGLAS FIR	RCPT	RECEPTACLE
DIA DIAG	DIAMETER DIAGONAL	REF.	REFERENCE
DIM	DIMENSION	reinf Req'd	REINFORCEMENT(ING)
DWG	DRAWING(5)	RG5	required Rigid Galvanized Steel
DWL	DOWEL(5)	SAF	SAFETY
EA	EACH	SCH	SCHEDULE
EGR EL	EMERGENCY GENERATOR RECEPTACLE ELEVATION	SDBC	SOFT DRAWN BARE COPPER
ELEC	ELECTRICAL	SEC	SECONDARY
ELEV	ELEVATOR	SHT SIM	SHEET SIMILAR
EMT	ELECTRICAL METALLIC TUBING	SN	SOLID NEUTRAL
EN	EDGE NAIL	SPEC	SPECIFICATION(S)
ENCL	ENCLOSURE	SQ.	SQUARE
eng Eq	engineer Equal	55	STAINLESS STEEL
EXST, (E)	EXISTING	STD STL	STANDARD STEEL
EXP	EXPANSION	STRUC	STRUCTURAL
EXT	EXTERIOR	SURF	SURPACE
FAB	FABRICATION(OR)	SW	SWITCH
FAC F/A	FACTOR FIRE ALABA	TEL_	TELEPHONE
fF	fire Alarm Finish floor	TEMP	TEMPORARY
FG	FINISH GRADE	THK TN	THICK(NESS) TOE NAIL
FIN	finish(ED)	TOA	TOP OF ANTENNA
FLR	FLOOR	TOC	TOP OF CURB
FLUOR	FLUORESCENT	TOF	TOP OF FOUNDATION
FDN FOC	FOUNDATION FACE OF CONCRETE	TOP	TOP OF PLATE (PARAPET)
FOM	FACE OF CONCRETE FACE OF MASONRY	TOS	TOP OF STEEL
FO S	FACE OF STUD	TOW TYP	TOP OF WALL
FOW	FACE OF WALL	TYP UG	TYPICAL UNDER GROUND
F5	FINISH SURFACE	UL	UNDERWRITERS LABORATORY INC.
FT, (¹)	FOOT (FEET)	UNO	UNLESS NOTED OTHERWISE
ptg Pu	FOOTING FUSE	V	VOLT
ΓU G	GROUND	VAC	VOLT ALTERNATING CURRENT
G₹	GROWTH (CABINET)	VIF	VERIFY IN FIELD
GA	GAUGE	W WD	WATT OR WIRE WIDE(WIDTH)
GEN	GENERATOR	W/	WITH
GALV	GALVANIZE(D)	w/o	WITHOUT
GFCI GLB	GROUND FAULT CIRCUIT INTERRUPTER GLUE LAMINATED BEAM	WD	WOOD
GND	GROUND	WP	WEATHERPROOF
GP S	GLOBAL POSITIONING SYSTEM	WT YPPD	WEIGHT TPANSPEP
GRND	GROUND	XFER XFMR	TRANSFER TRANSFORMER
HDBC	HARD DRAWN COPPER WIRE	XI-PE	CROSS-LINK POLYETHYLENE
HDG	HOT-DIP GALVANIZE(D)	C	CENTERLINE
HDR HGR	HEADER HANGER	e	PLATE
HPS	HIGH PRESSURE SODIUM		
	A COLOR OF THE PROPERTY OF THE		





CRAN RSFR LOSAO 12

356 BLUE OAK LN LO5 ALTO5, CA 94022

	ISSUE STATUS						
\triangle	DATE	DESCRIPTION					
	06/19/18	CD 90%					
	07/25/19	CD 100%					
RAWN	I BY:	O. REDDISH					
HECK	ED BY:	T. DICARLO					
PRO	VED BY:	В. МсСОМВ					
ATE:		07/25/19					

GENERAL NOTES, LEGEND, **# ABBREVIATIONS**

SHEET TITLE:

SHEET NUMBER

SURVEY. THE CONTRACTOR SHALL ASSUME SOLE LIABILITY FOR ANY FAILURE TO NOTIFY THE ARCHITECT/ ENGINEER.

OFFICIAL HAVING JURISDICTION.

BY THE ARCHITECT/ ENGINEER. FAILURE TO SECURE SUCH INSTRUCTION MEANS CONTRACTOR WILL HAVE WORKED AT HIS/HER OWN RISK AND EXPENSE,

PROJECT.


15. ALL EQUIPMENT LOGOS, OTHER THAN THOSE REQUIRED BY REGULATION (E.G. NODE IDENTIFICATION OR SHTUDOWN SIGNAGE) OR PG&E REGULATIONS SHALL BE PAINTED OVER OR REMOVED. RAISED/DEPRESSED LOGOS OR TEXT ON EQUIPMENT (E.G. RRUS), IF PRESENT, TO BE SANDED OFF OR COVERED WITH STICKER, & THEN PAINTED OVER.


NEW ANTENNA

SYMBOLS LEGEND


<u> </u>	HEAA UNITHINU	23 con est una ser soma con escribilità de la constante de la	GROOT OR I ESTER	•	TECO NON		BELOW GRADE.
	EXISTING ANTENNA		(E) BRICK	—— P/T ——	- POWER/TELCO RUN	Θ	CHEMICAL GROUND ROD
\otimes	GROUND ROD		(E) MASONRY	G	- GROUNDING CONDUCTOR	<u> </u>	(XIT GROUND ROD)
	GROUND BUSS BAR		CONCRETE	G	CASIMUMO COMBISTOR		CADWELD CONNECTION
•	MECHANICAL GRND, CONN.		EARTH		- GROUNDING CONDUCTOR		MECHANICAL CONNECTION
\bigcirc	GROUND ACCESS WELL		GRAVEL		- CONDUIT UNDERGROUND	4	HALO GROUND CONNECTION
E	ELECTRIC BOX		PLYWOOD			•	
T	TELEPHONE BOX		SAND	-[]-	FUSE, SIZE AND TYPE AS INDICATED.		CIRCUIT BREAKER
			WOOD CONT.		SAFETY SWITCH, 2P-240V-60A W/60A FUSES, NEMA 3R ENCLOSURE, SQ D CATALOG NO. H222NRB		UTILITY METER BASE
*	LIGHT POLE		WOOD BLOCKING				
	FND. MONUMENT		STEEL		MANUAL TRANSFER SWITCH, 2P-240V-200A, NO FUSE, NEMA 3R ENCLOSURE		TRANSFORMER
•	SPOT ELEVATION		CENTERLINE		LIGHTING FIXTURE, FLUORESCENT, 10.94" x 4'-0", 2/40W, SURFACE MOUNTING TYPE, HUBBELL LIGHTING CATALOG	Т	STEP-DOWN TRANSFORMER
^			PROPERTY/LEASE LINE		#WSW232T LIGHTING FIXTURE, FLUORESCENT, 10.94" x 8'-0", 2/95W,	<u> </u>	
	SET POINT		MATCH LINE		SURFACE MOUNTING TYPE, HUBBELL LIGHTING CATALOG #TWSM232T	\bigoplus	RECEPTACLE, 2P-3W-125V-15A, DUPLEX, GROUND TYPE, HUBBELL CATALOG #5362
\triangle	REVISION		WORK POINT	\vdash	LIGHTING FIXTURE, HIGH PRESSURE SODIUM, 1/70W, WALL MOUNTING TYPE, HUBBELL LIGHTING CATALOG #NRG-307 OR 1/50W, HUBBELL LIGHTING CATALOG #NRG-121	S	TOGGLE SWITCH, IP-125V-15A, HUBBELL CATALOG #HBL 1201CN
(\mathbf{x})	GRID REFERENCE		GROUND CONDUCTOR		EXIT SIGN, THERMOPLASTIC LED, SINGLE FACE, UNIVERSAL MOUNTING,	S _{WP}	TOCCLE CHUTCH IR LOOK LEA BLOW
XXX	DETAIL REFERENCE	—— СПАХ ——	COAXIAL CABLE	⊢⊗	W/BATTERY PACK, HUBBELL LIGHTING CATALOG #PRB	WP	TOGGLE SWITCH, IP-120V-15A, "WP"
		— · 0/U · —	OVERHEAD SERVICE CONDUCTORS	EXIT	COMBINATION, EXIT SIGN & EMERGENCY LIGHTING, HUBBELL LIGHTING CATALOG #PRC	S	IONIZATION SMOKE DETECTOR WALARM HORN & AUXILIARY CONTACT, 120 VAC, GENTEX PART NO. 7100F
XXX	ELEVATION REFERENCE	—— X——— X——	CHAIN LINK FENCING		EMERGENCY LIGHTING, 2/50W, HUBBELL LIGHTING CATALOG #HEG-50-2-R91		POLE
		OHT/OHP	OVERHEAD TELEPHONE/OVERHEAD POWER		LIGHTING FIXTURE, INCANDESCENT, 1/100W, WALL		
X-X	SECTION REFERENCE	—— ОНТ ——	OVERHEAD TELEPHONE LINE	Ю	MOUNTING TYPE, HUBBELL LIGHTING CATALOG #BRH-100-06-1		(N) POLE MOUNTED XFMER
		——OHP ——	OVERHEAD POWER LINE		LIGHTING FIXTURE, HALOGEN, QUARTZ, 1/300W, HUBBELL LIGHTING CATALOG #QL-505	\triangle	(E) POLE MOUNTED XFMR
		—— Р ——	POWER RUN	HX	LIGHTING FIXTURE, 1/175W. METAL HALIDE, HUBBELL CAT #MIC-0175H-336		(N) PAD MOUNTED XFMER
					5/8" X 10'-0", Cu. GND ROD 18" MIN. BELOW GRADE.		(E) PAD MOUNTED XFMER


T TELCO RUN

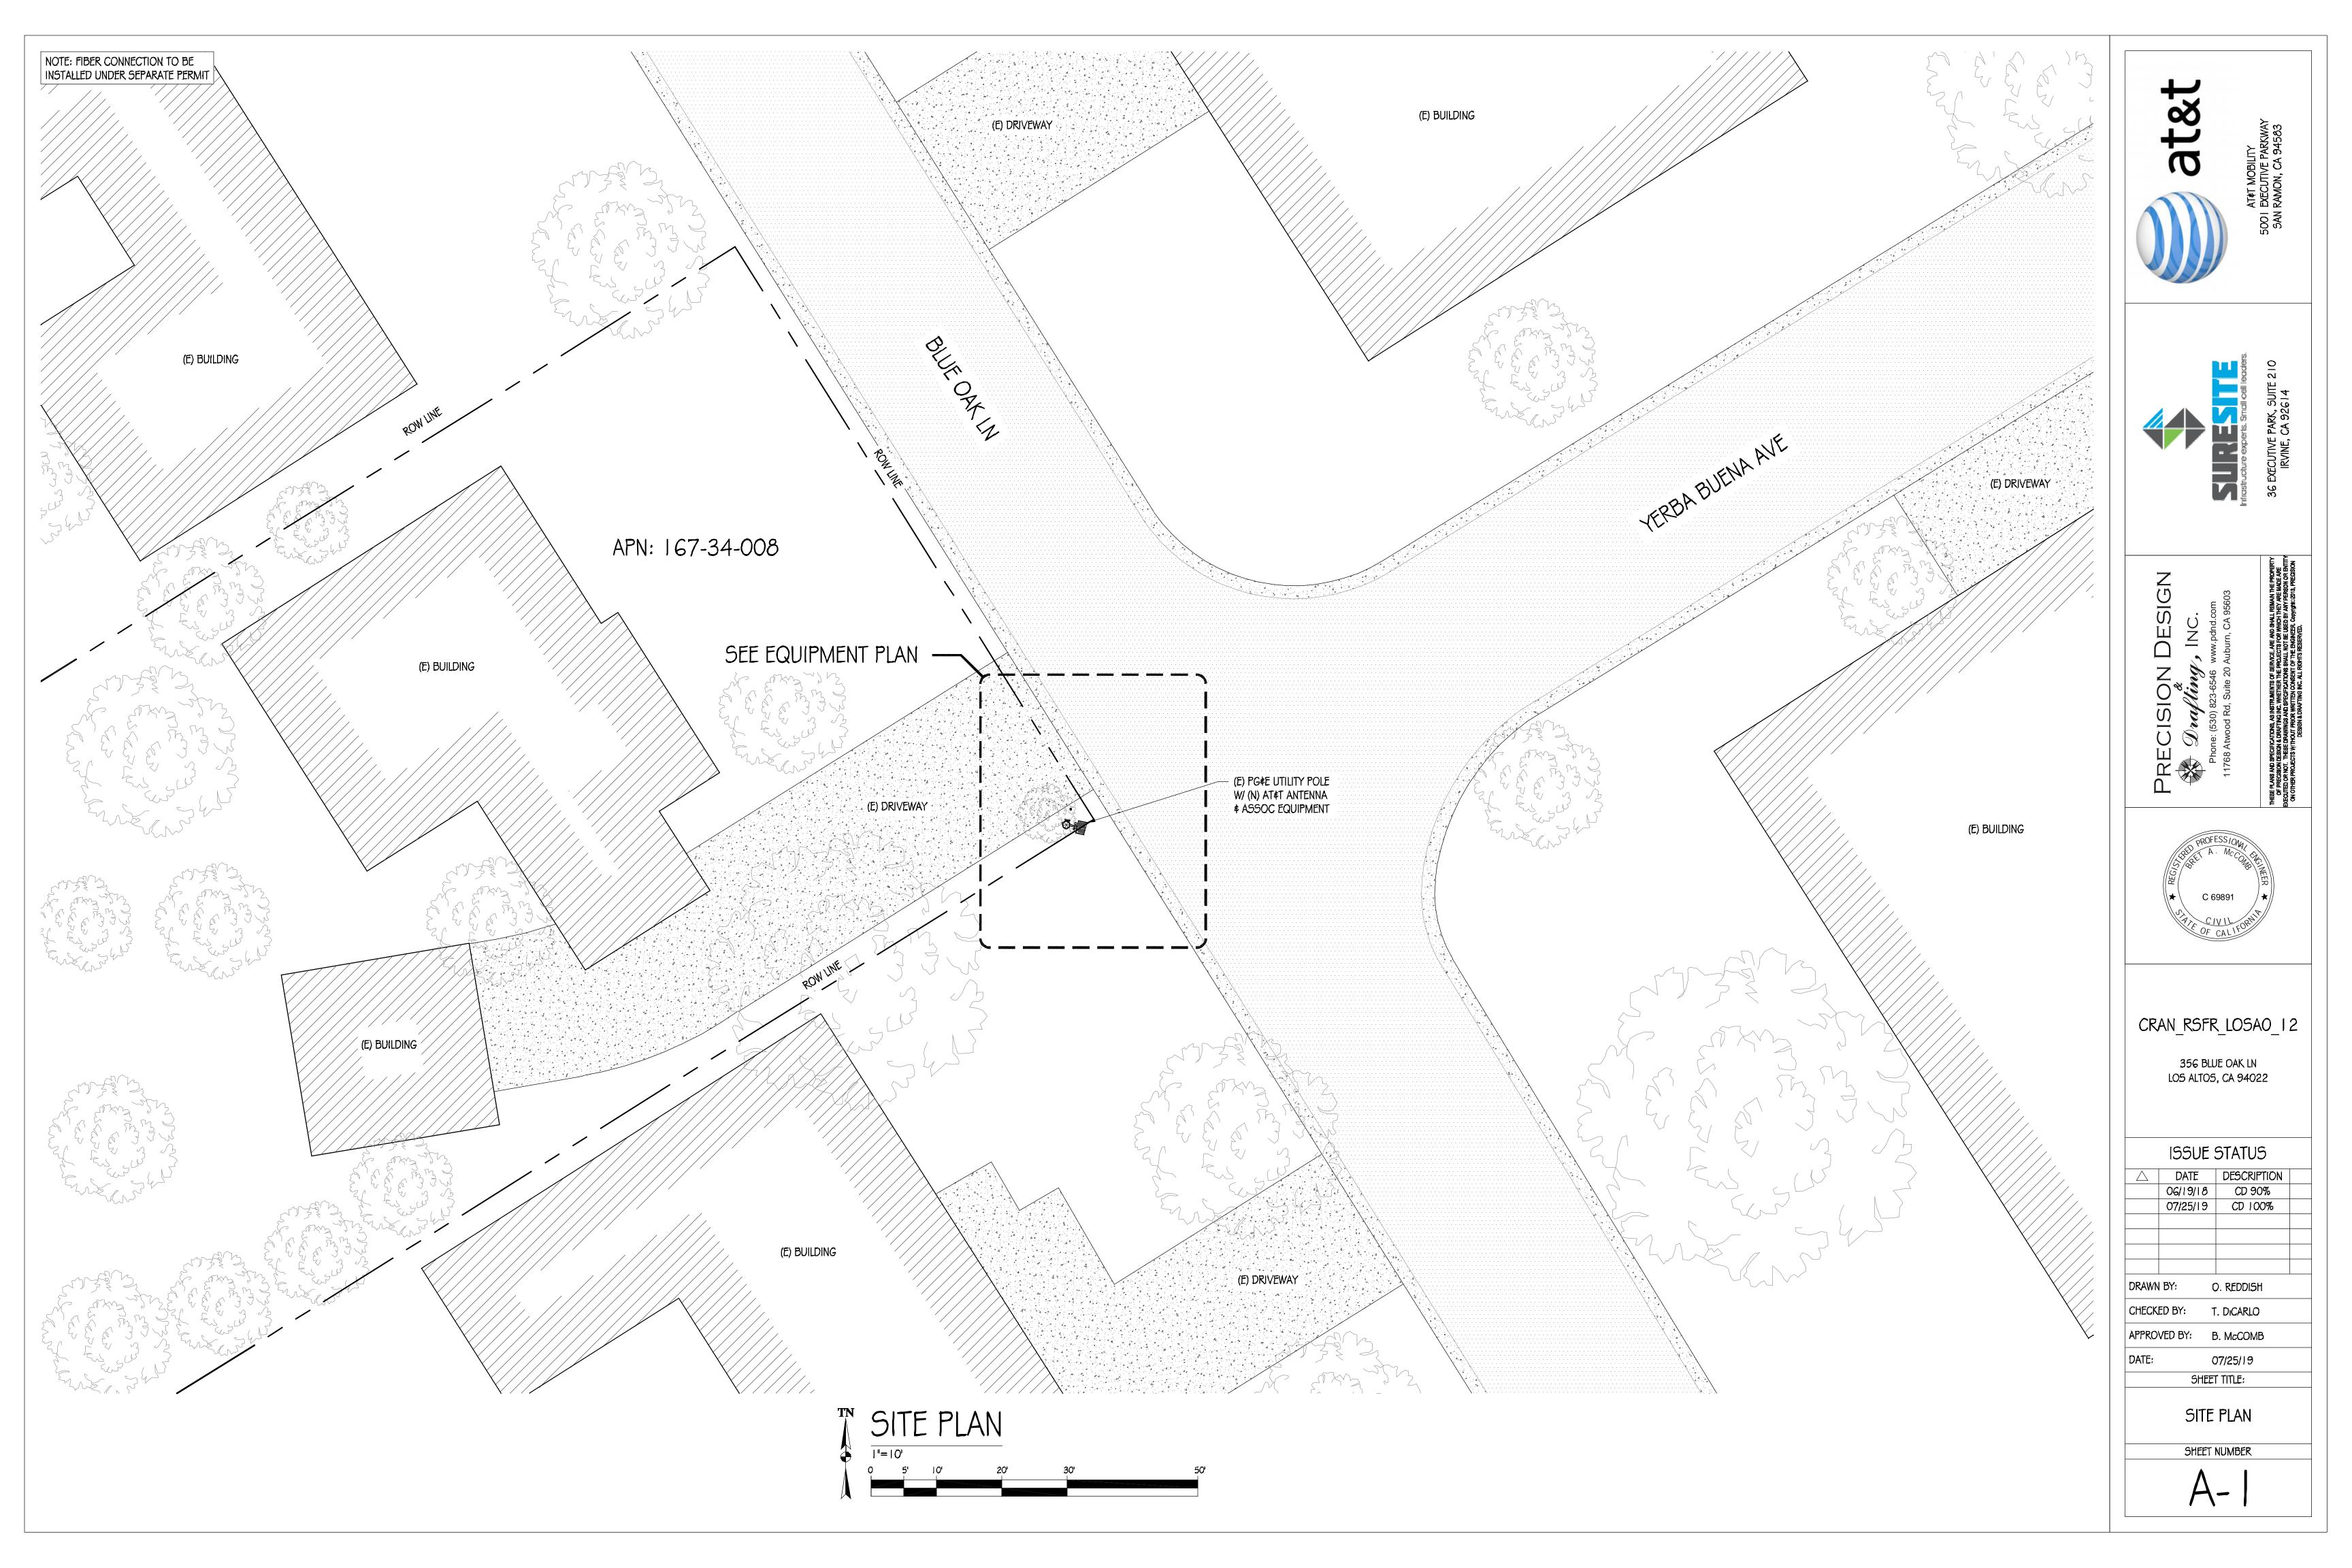

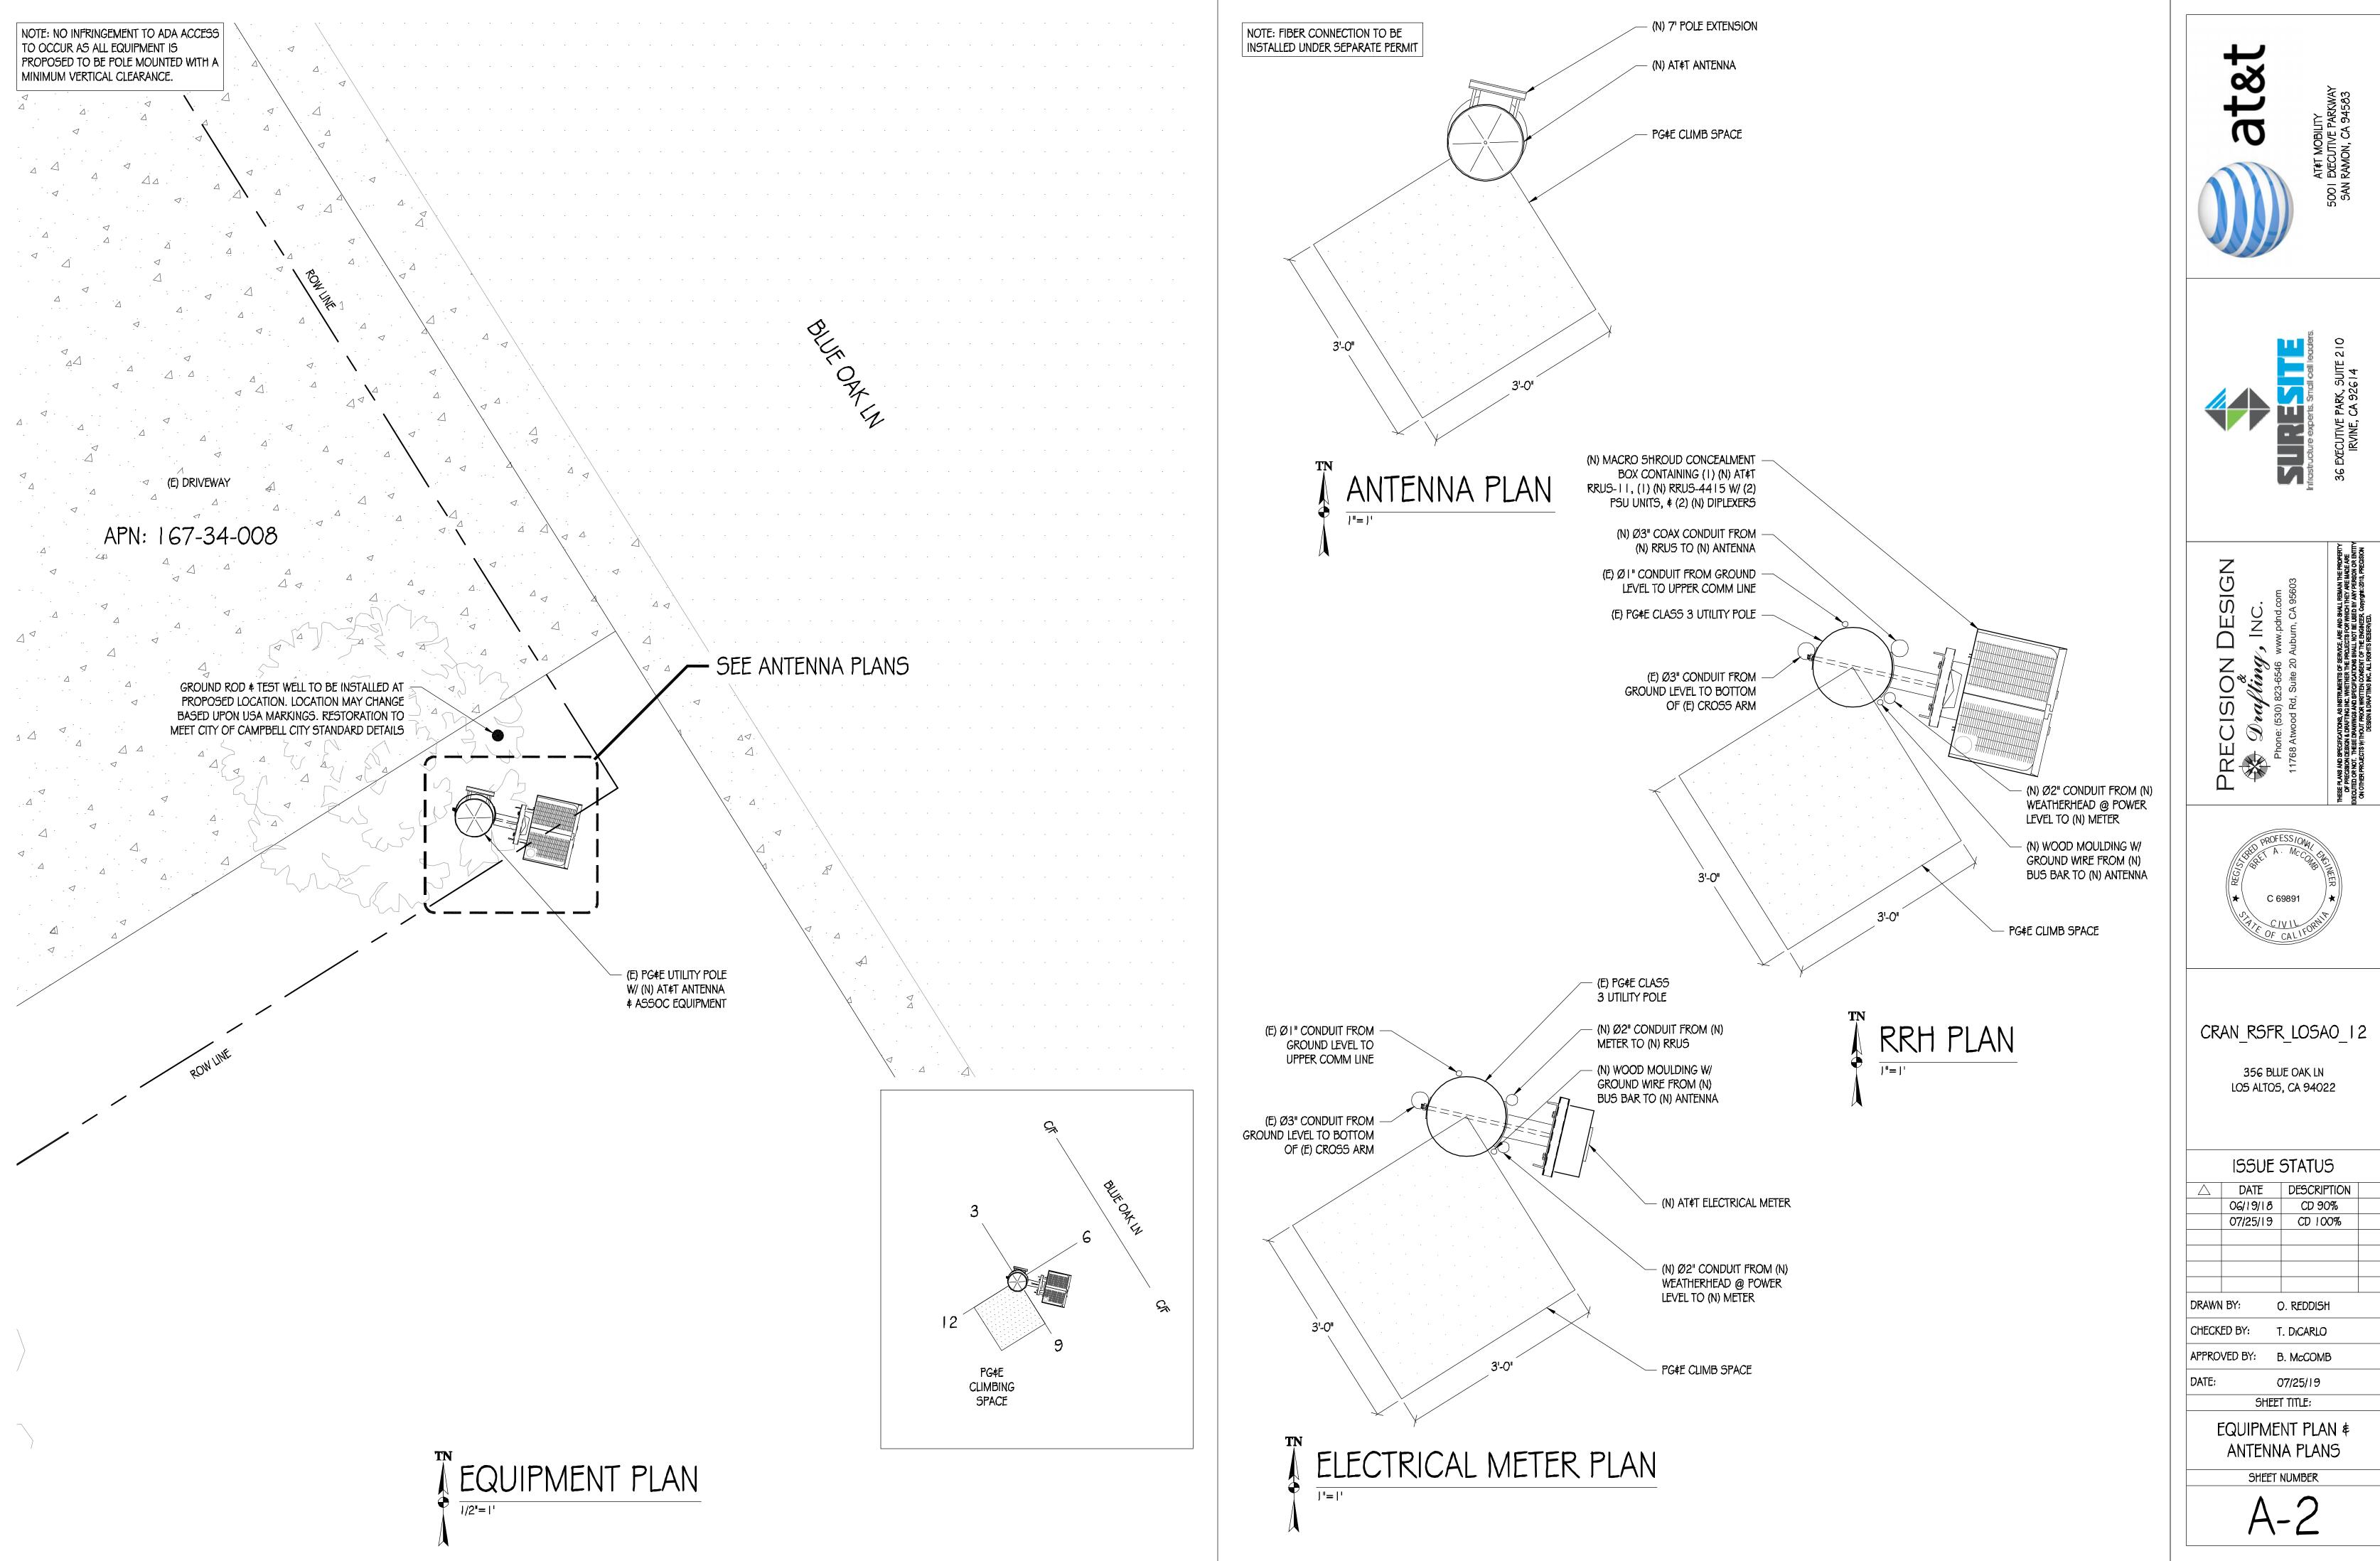

	ISSUE	STATUS
\triangle	DATE	DESCRIPTION
	06/19/18	CD 90%
	07/25/19	CD 100%
DRAWN	I BY:	O. REDDISH
CHECK	ED BY:	T. DICARLO
APPRO	VED BY:	В. МсСОМВ
DATE:		N7/25/19

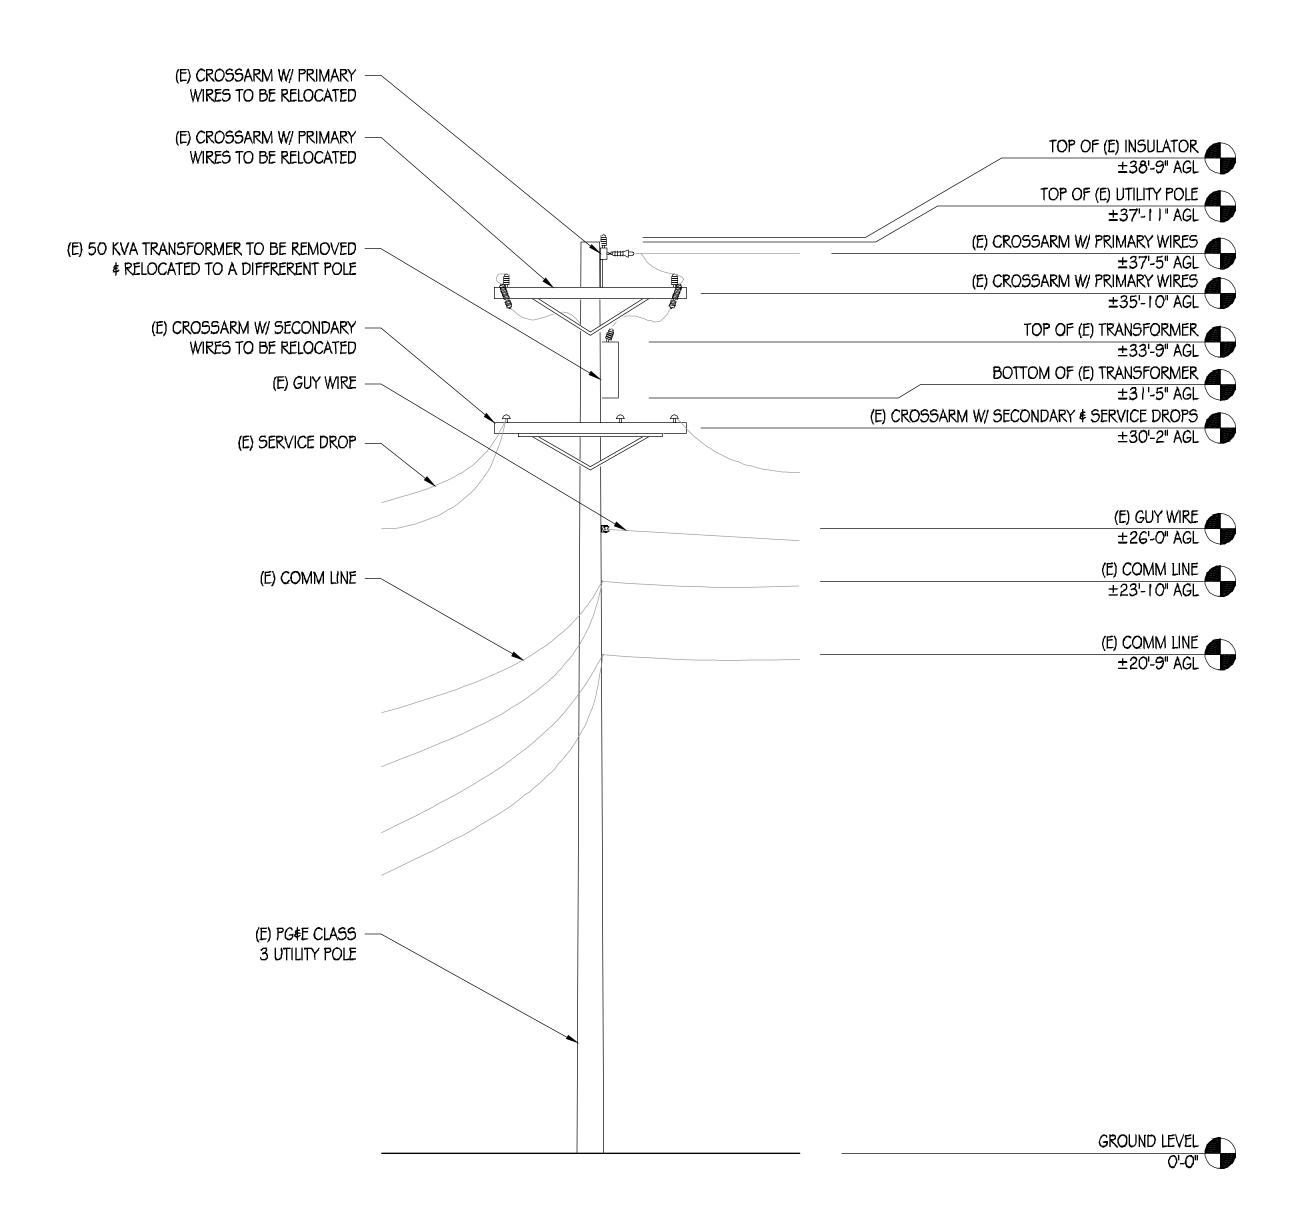

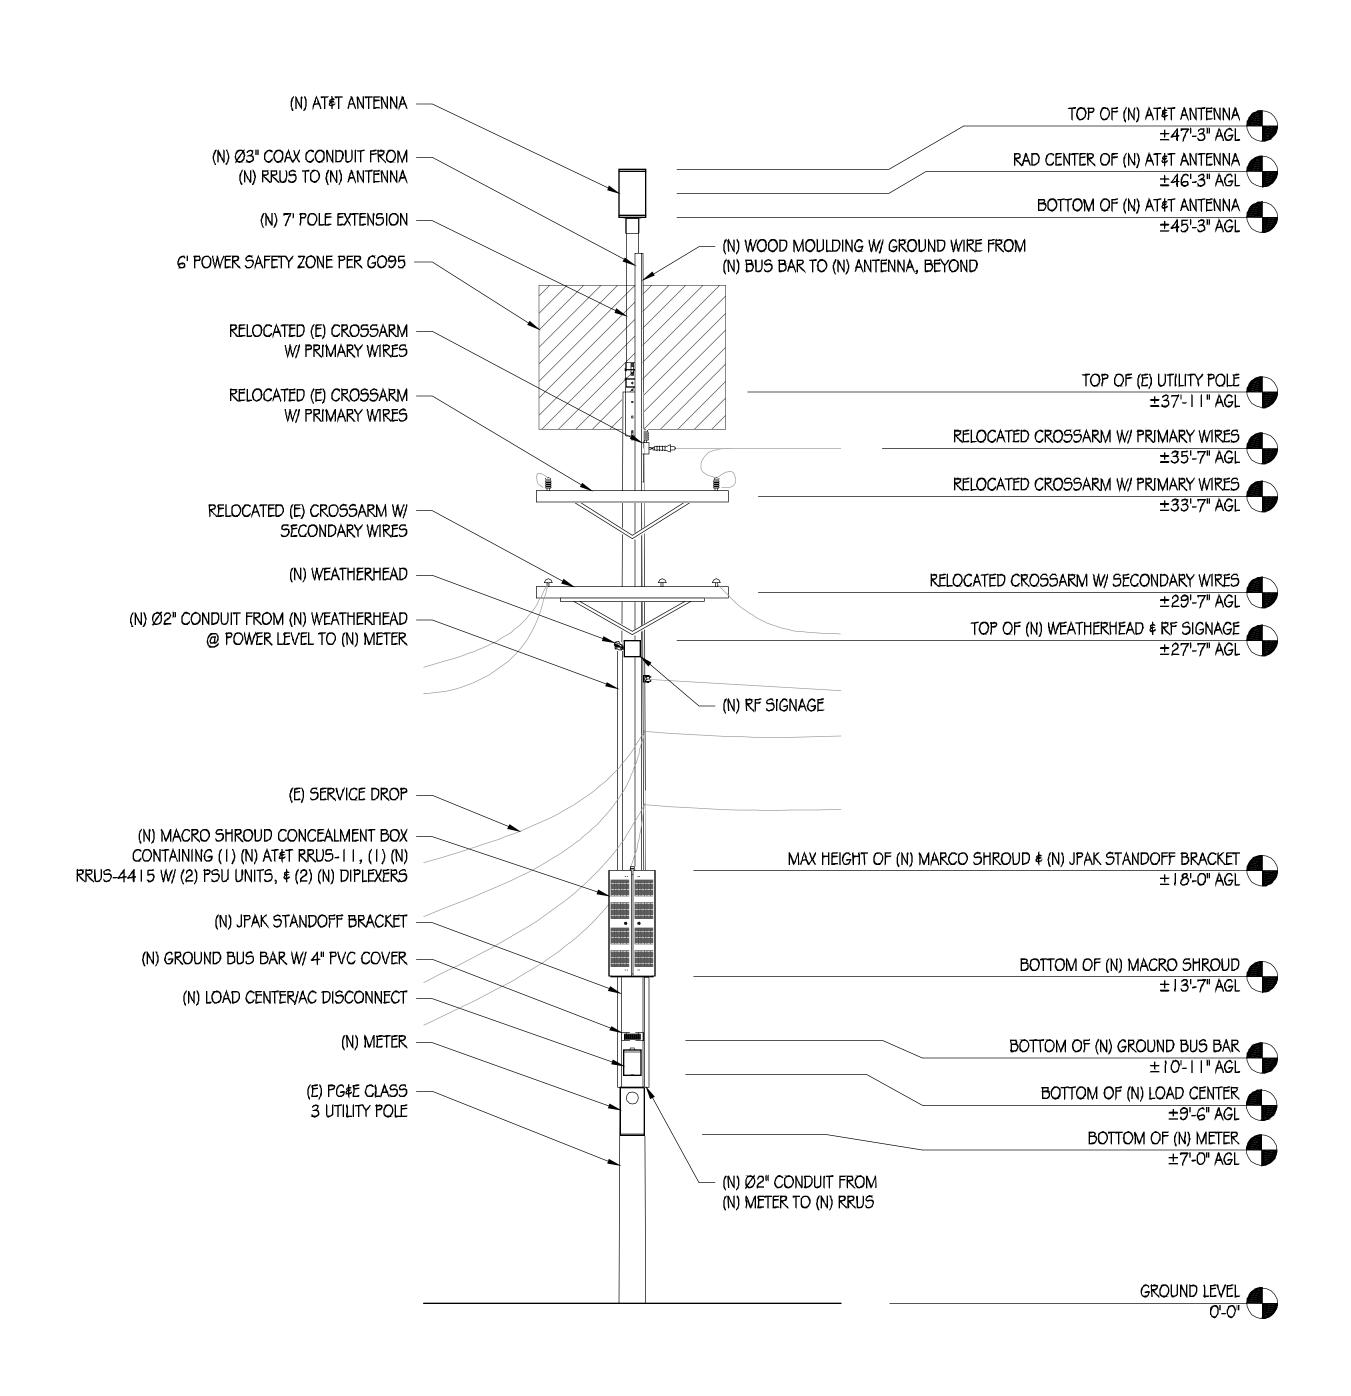

EXISTING EAST ELEVATION

NEW EAST ELEVATION

1/4"=1'-0"







CRAN_RSFR_LOSAO_12

356 BLUE OAK LN LOS ALTOS, CA 94022


	ISSU	E:	STATUS	
\triangle	DATE		DESCRIPTION	
	06/19/1	8	CD 90%	
	07/25/1	9	CD 100%	
DRAWN	BY:	(). Reddish	
CHECK	ED BY:	1	. DICARLO	
APPRO	VED BY:	E	В. МсСОМВ	
DATE:		()7/25/1 9	


ELEVATIONS

SHEET TITLE:

SHEET NUMBER

A-3

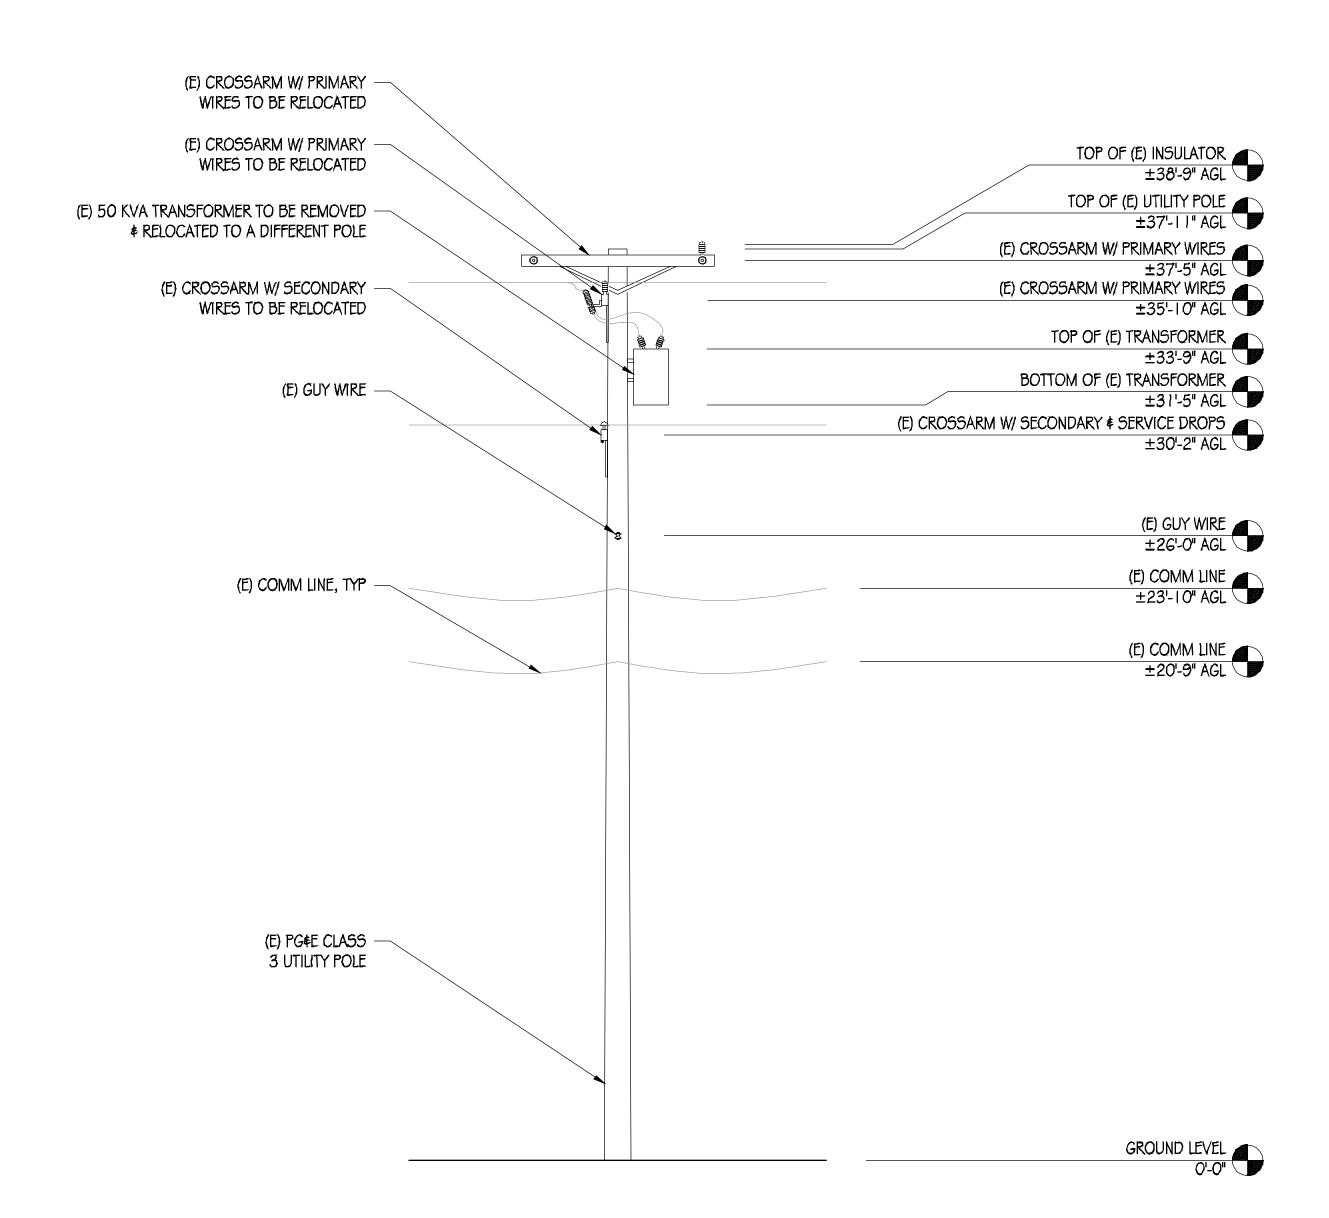

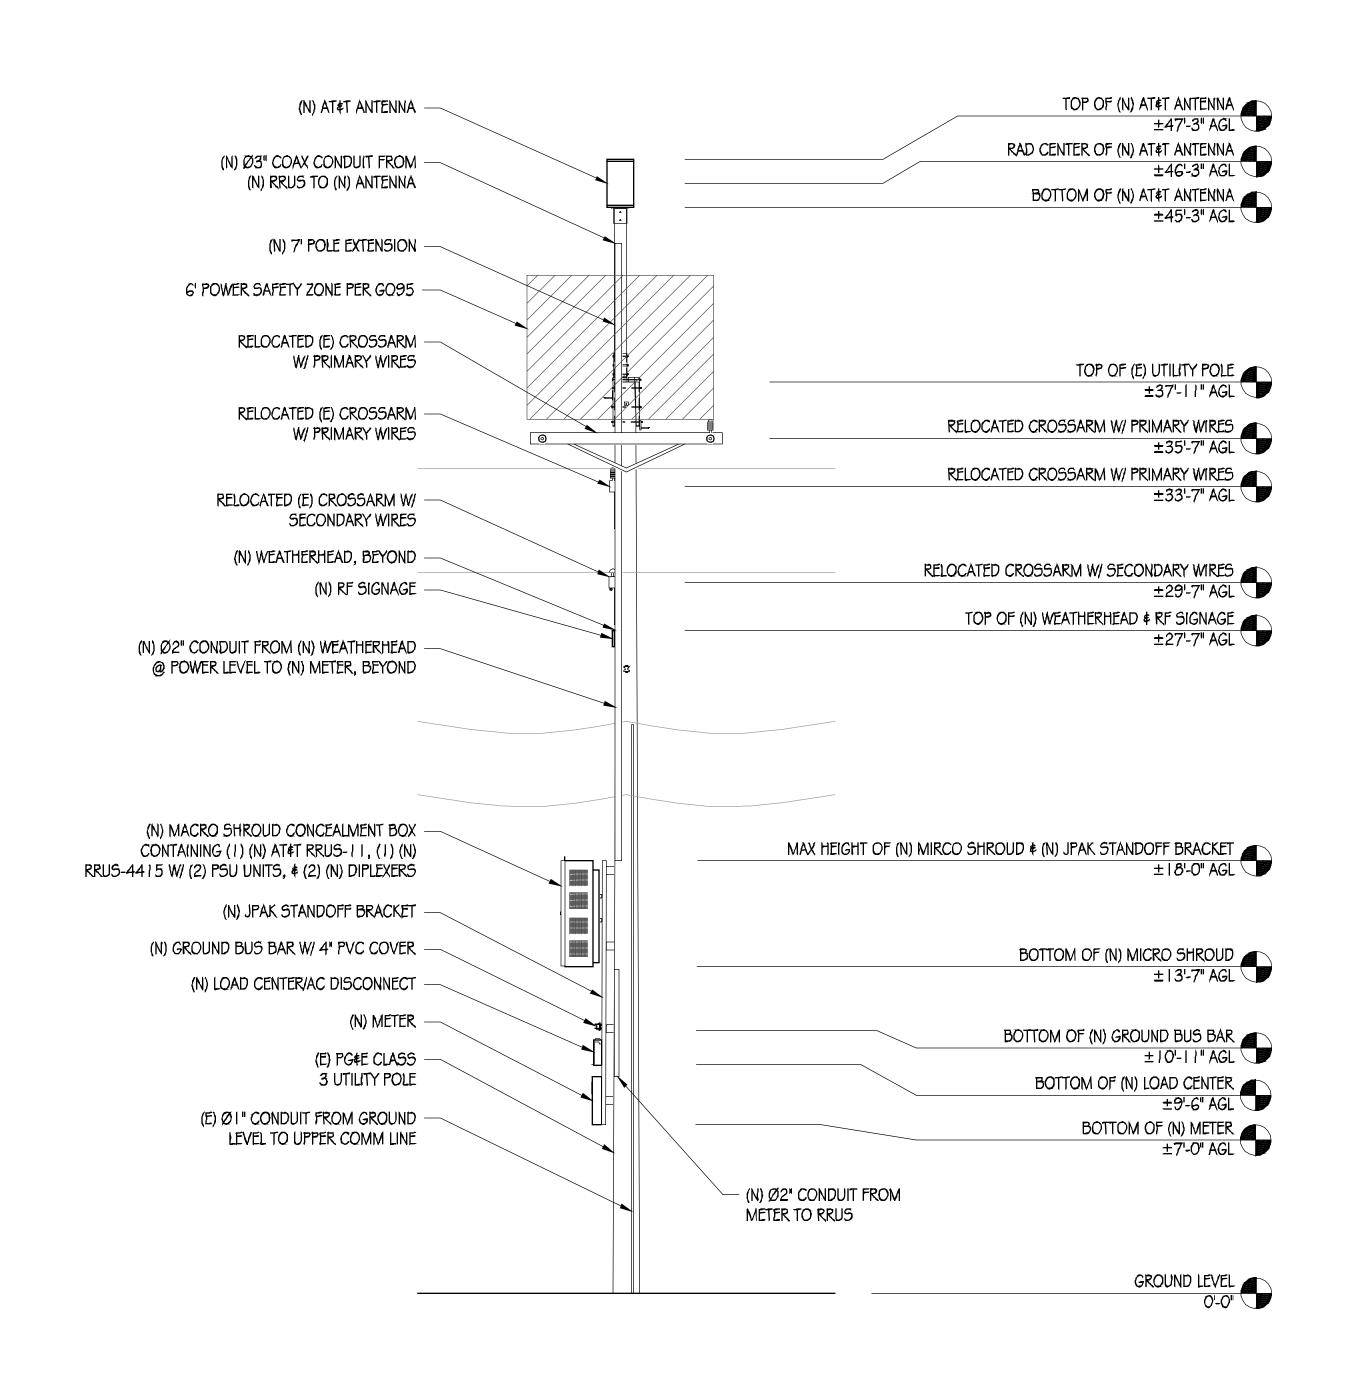

EXISTING NORTH ELEVATION

NEW NORTH ELEVATION





Phone: (530) 823-6546 www.pdnd.com
11768 Atwood Rd, Suite 20 Auburn, CA 95603



CRAN_RSFR_LOSAO_12

356 BLUE OAK LN LOS ALTOS, CA 94022

	ISSUE STATUS					
\triangle	DATE		DESCRIPTION			
	06/19/1	8	CD 90%			
	07/25/1	9	CD 100%			
DRAWN	I BY:	C). REDDISH			
CHECK	ED BY:	1	. DICARLO			
APPRO	VED BY:	E	В. МсСОМВ			
DATE:			7/25/19			

ELEVATIONS


SHEET TITLE:

SHEET NUMBER


A-4

POLE-TOP EXTENSION NOTES:

- I. THIS UNIT MEETS GENERAL ORDER (G.O.) 95 REQUIREMENTS FOR STRENGTH IN CLASS 6 POLES AND THEREFORE MAY BE USED TO SUPPORT EQUIPMENT ON THESE CLASSES OF POLES. IT MAY BE USED ON LARGER CLASS POLES, BUT MAY NOT BE USED TO SUPPORT EQUIPMENT ON THEM.
- 2. THE UNIT MAY BE GUYED.
- 3. THE BRACKET IS MADE TO FIT POLES WITH DIAMETERS OF 8"-11". THEREFORE, DEPENDING UPON THE ACTUAL POLE-TOP DIAMETER, TO FIT POLES OF CLASS 3 AND SMALLER, A BRACKET ADAPTER MAY BE REQUIRED.
- 4. UNITS ARE SUPPLIED WITH THE WOOD BAYONET ASSEMBLED.
- 5. A POLE STEP KIT IS REQUIRED.
- 6. ATTACH THE BRACKET ASSEMBLY ACROSS THE LINE DIRECTION WITH THE CROSS ARM.
- 7. ALL DETAILS SHOWN ON THIS PAGE ARE FOR REFERENCE ONLY. THE POLE-TOP EXTENSION AND ANTENNA MOUNTING SYSTEMS ARE PER UTILITY COMPANY STANDARDS AND ARE SUBJECT TO CHANGE AT THEIR DISCRETION. BOTH THE POLE-TOP EXTENSION AND ANTENNA MOUNTING SYSTEM SHALL BE INSTALLED BY THE UTILITY COMPANY.

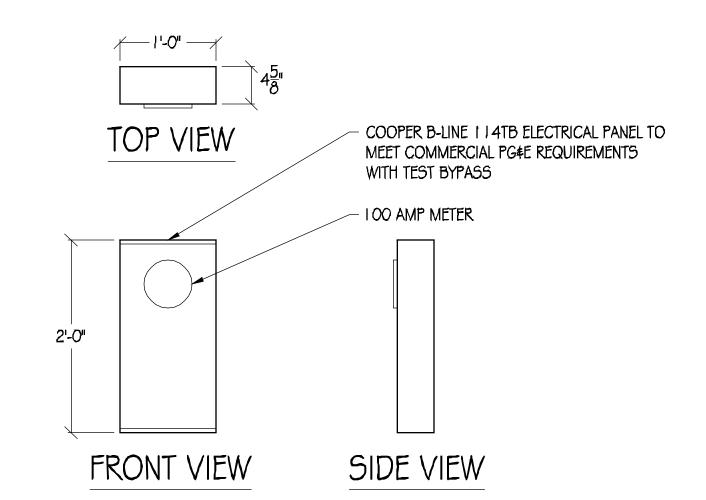




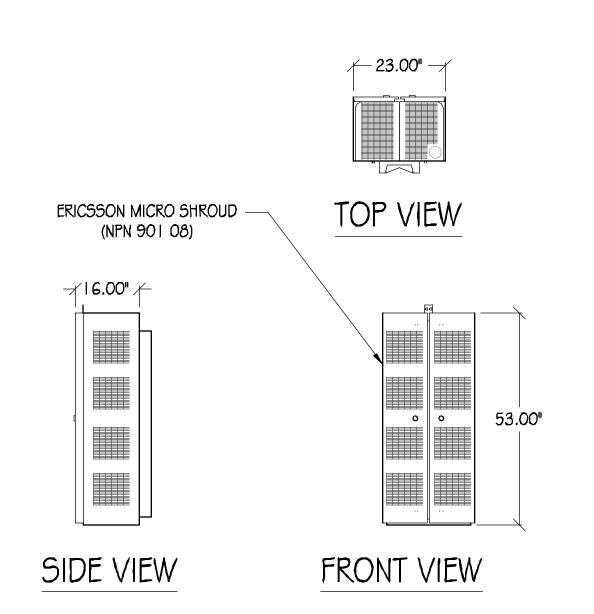




KMW FX-OM2L10H2-06T

WIND AREA: WEIGHT: **DIMENSIONS:** RF CONNECTORS: 2.67 5Q FT 34.2 LBS Ø16.0" X 24.0" TALL (12) 4.3-10 FEMALE










ERICSSON RRUS-4415

TOTAL WEIGHT: DIMENSIONS:

UNDER 46 LBS 16.5" X 13.4" X 5.9"



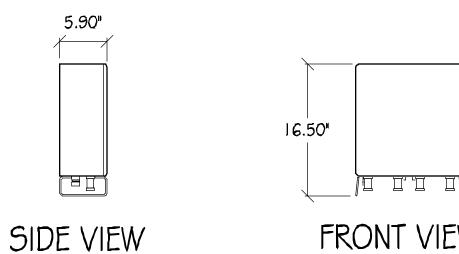





BRIDGEPORT ALUMINUM

CONDUIT #1256 OR EQUIV

WEATHER HEAD FOR 2"


WEATHER HEAD

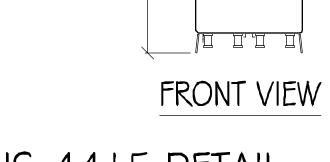

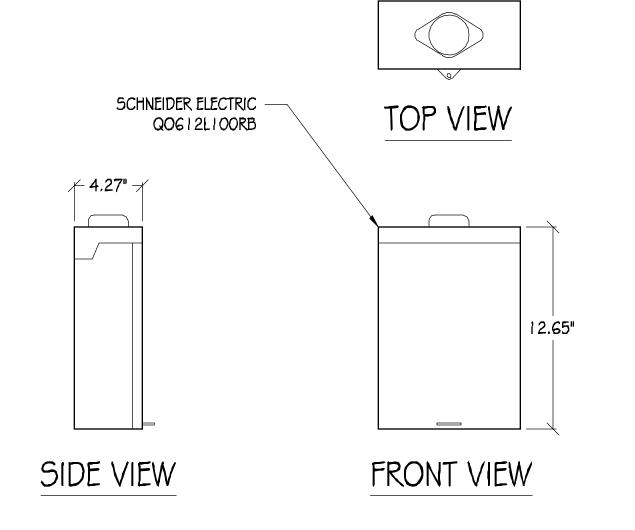




COMMSCOPE ERICSSON RRUS-11 CBC1923T-4310/ E11F13P06 55 LBS 19.7" TALL X17" WIDE X 7.2" DEEP COLOR: GRAY TOTAL WEIGHT: +/- 4,4 LB DIMENSIONS: 8.3" TALL X 4.6"







TOTAL WEIGHT:

DIMENSIONS:

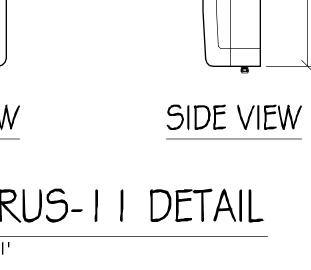

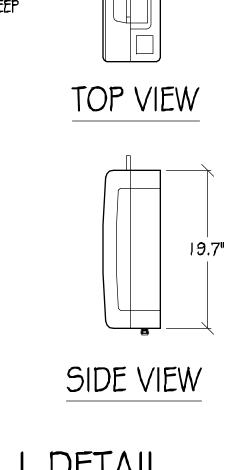




ERICSSON PSU AC 08


DIMENSIONS: 2.72" X 10.79" X 7.09"

WEIGHT:

11.46 LB5 **GROUNDING INTERFACE**

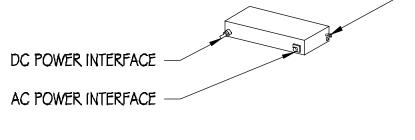



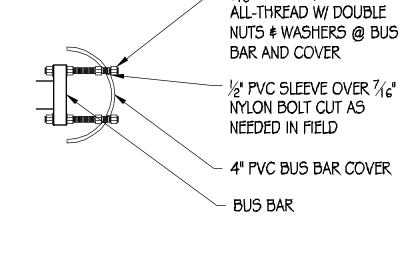

TOP VIEW

FRONT VIEW

7/16" NYLON 6/6

WIDE X 1.8" DEEP

CBC1923T-4310

DIPLEXER


DIPLEXER DETAIL

(1.8")

SIDE VIEW

(4,6")



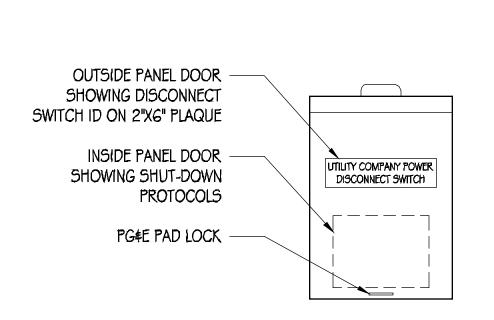

SHUTDOWN DISCONNECT NORMAL SHUT-DOWN PROTOCOLS 1, CALL (800) G38-2822 NOC 24HRS PRIOR TO SCHEDULE A SHUT-DOWN DAY AND 2, GIVE NOC THE NODE NUMBER_ 4. CALL NOC WHEN WORK IS COMPLETED EMERGENCY SHUT-DOWN PROTOCOLS 1. CALL (600) 638-2822 NOC 2, GIVE NOC THE NODE NUMBER_ 3. PULL THE DISCONNECT HANDLE TO THE 'OFF' POSITION. 4. CALL NOC WHEN THE WORK (5 COMPLETED,


SHUT-DOWN PROTOCOL ON 3"X4" LABE



I . SITE ID WILL BE SWITCH #, SITE # \$ SITE NAME 2. SIGN PROVIDED BY GC MOUNTED TO OUTSIDE OF SERVICE DISCONNECT







CRAN_RSFR_LOSAO_12

356 BLUE OAK LN LOS ALTOS, CA 94022

ISSUE STATUS					
\triangle	DATE	DESCRIPTION			
	06/19/18	CD 90%			
	07/25/19	CD 100%			
DRAWN	I BY: (O. REDDISH T. DICARLO B. McCOMB			
CHECK	ED BY: 1				
APPRO	VED BY:				
DATE:	(07/25/19			


DETAILS SHEET NUMBER

A-5


SHEET TITLE:

STRUCTURAL STEEL NOTES:

- ALL STEEL CONSTRUCTION INCLUDING FABRICATION, ERECTION AND MATERIALS SHALL COMPLY WITH ALL REQUIREMENTS OF THE AISC SPECIFICATION FOR THE DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS AND THE 2016 CBC.
- 2. ALL STRUCTURAL STEEL SHALL BE ASTM A36 UNLESS OTHERWISE NOTED. ALL WF (WIDE FLANGE) \$ WT (TEE) SHAPES TO BE ASTM A992 (F_Y=50,000 PSI) UNLESS NOTED OTHERWISE. ALL STRUCTURAL TUBING (TS OR HSS) SHALL BE ASTM A500 GRADE B (F_Y =46,000 PSI). ALL STEEL PIPE SHALL BE ASTM A53 (TYPE E OR S, GRADE B (Fy=35,000 PSI)) SCHEDULE 40 WITH OUTSIDE DIAMETERS GIVEN UNLESS OTHERWISE NOTED.
- 3. ALL WELDING SHALL BE PERFORMED USING E70XX ELECTRODES AND SHALL CONFORM TO AISC \$ AWS DI.I. WHERE FILLET WELD SIZES ARE NOT SHOWN PROVIDE THE MINIMUM SIZE PER TABLE J2.4 IN THE AISC SPECIFICATION. PAINTED SURFACES SHALL BE TOUCHED UP.
- 4. ALL WELDING SHALL BE PERFORMED BY QUALIFIED, CERTIFIED WELDERS.
- 5. BOLTS SHALL BE GALVANIZED ASTM A325 MINIMUM, BOLTED CONNECTIONS SHALL BE BEARING TYPE. SEE PLANS FOR LOCATION, NUMBER, \$ SIZE OF BOLTS. SPECIAL INSPECTION NOT REQUIRED U.O.N.
- 6. THREADED RODS SHALL BE ASTM F593 CW 304/316 STAINLESS STEEL. BOLTED CONNECTIONS SHALL BE BEARING TYPE. SEE PLANS FOR LOCATION, NUMBER, \$ SIZE OF BOLTS.
- 7. ALL HOLES FOR BOLTED CONNECTIONS SHALL BE 1/16" LARGER THAN THE NOMINAL BOLT DIAMETER. USE STANDARD AISC GAGE AND PITCH FOR BOLTS EXCEPT AS NOTED OTHERWISE. HOLES FOR ANCHOR BOLTS IN BASE PLATES MAY BE AISC "OVERSIZE" HOLES WHERE ACCOMPANIED BY OVERSIZED HARDENED HDG WASHERS.
- 8. ALL SHOP FABRICATED STEEL STRUCTURAL MEMBERS FOR EXTERIOR USE SHALL BE HDG PER ASTM A I 23 AFTER FABRICATION & PAINTED PER CUSTOMER SPECIFICATIONS AS REQUIRED. STEEL FOR INTERIOR USE SHALL BE SHOP COAT OR GALVANIZED & PAINTED PER PLAN.
- 9. ALL FIELD FABRICATED GALVANIZED STEEL THAT IS CUT, GROUND, DRILLED, WELDED OR DAMAGED SHALL BE TREATED WITH "ZINC RICH" COLD GALVANIZING SPRAY OR COATING. NO RAW STEEL SHALL BE
- IO. AT ALL WEB STIFFENER PLATES LEAVE $^3\!\!4$ "Ø (OR K, WHICHEVER IS LARGER) HOLE @ WEB/FLANGE INTERSECTION UNLESS NOTED OTHERWISE.

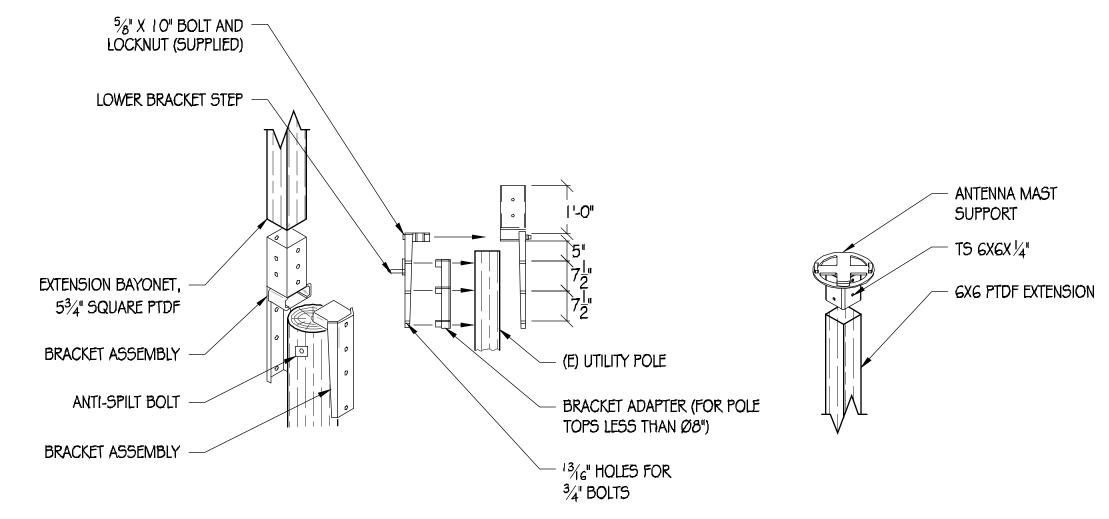




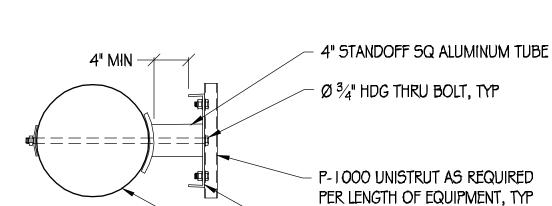

3/8" ALUMINUM C-CHANNEL TOP VIEW WOOD PG#E POLE


JPAK STANDOFF DETAIL

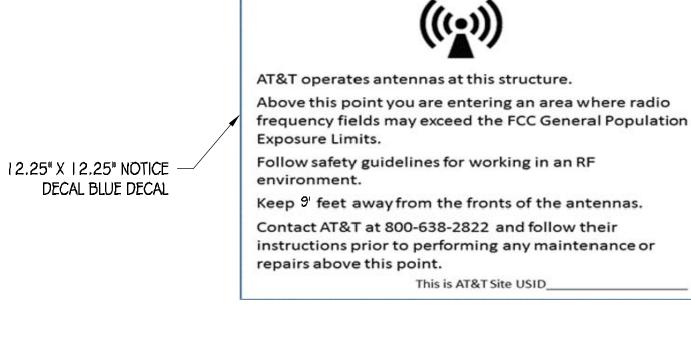



NOTICE SIGNAGE

NOTICE

- SIGNAGE TO BE SCREWED DIRECTLY TO POLE AT ALL FOUR CORNERS.
- SIGNAGE TO BE PLACED A MINIMUM OF 2'-0" BELOW (N) ANTENNA

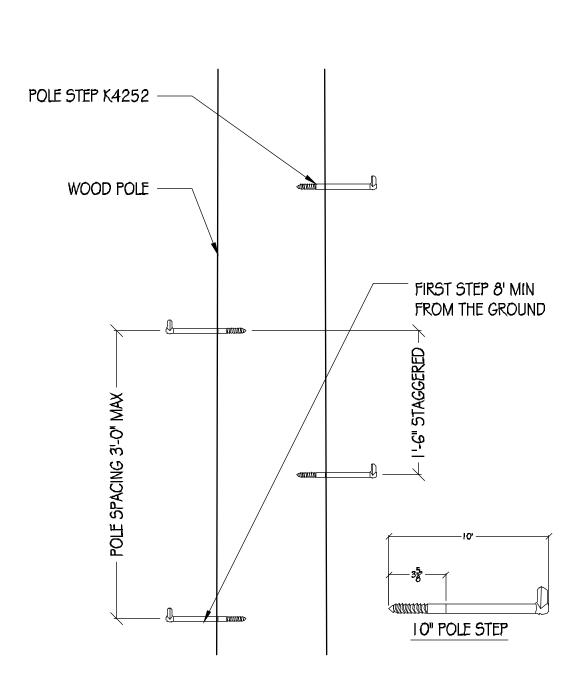





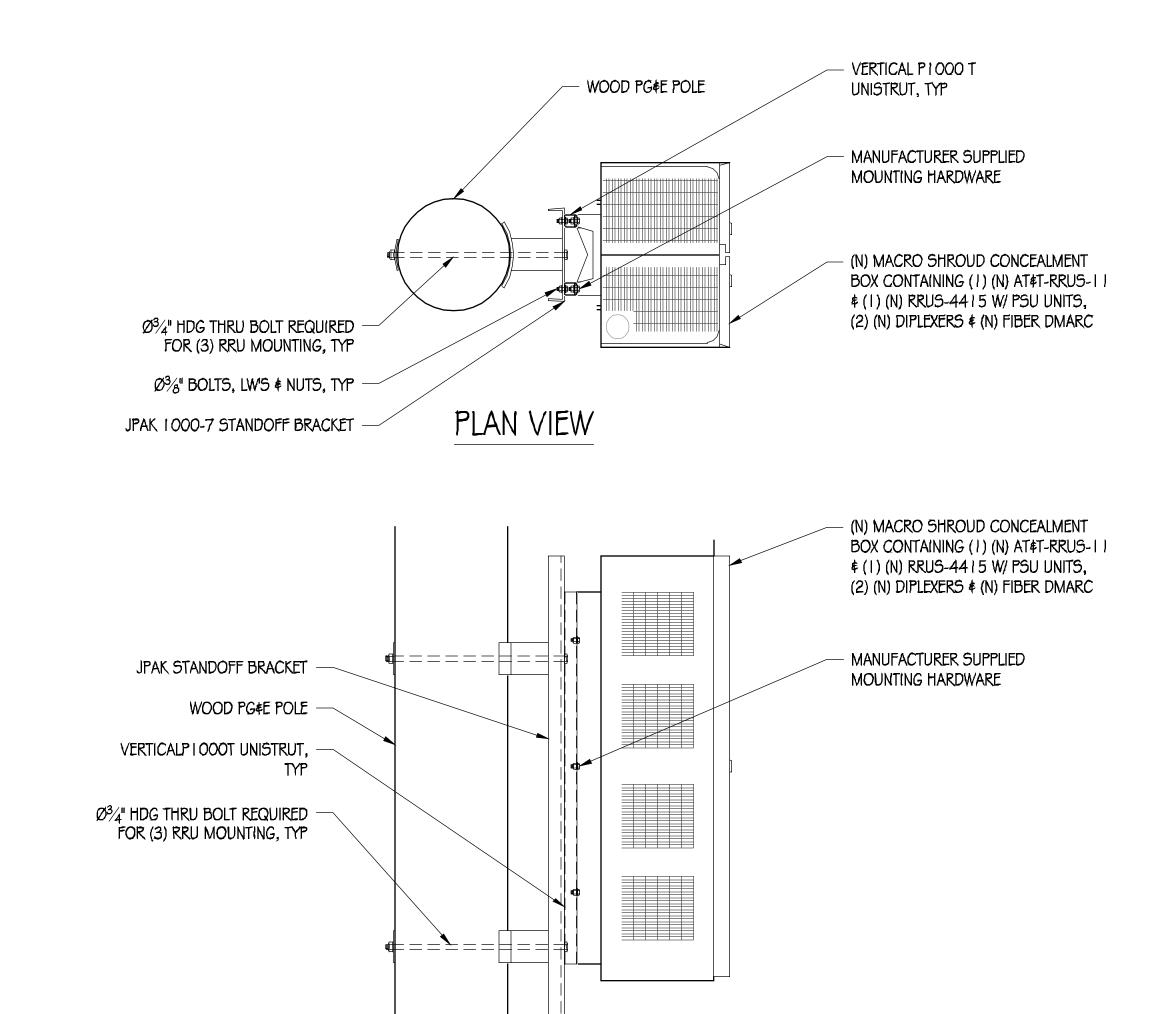


SIDE VIEW


RRU MOUNTING DETAIL

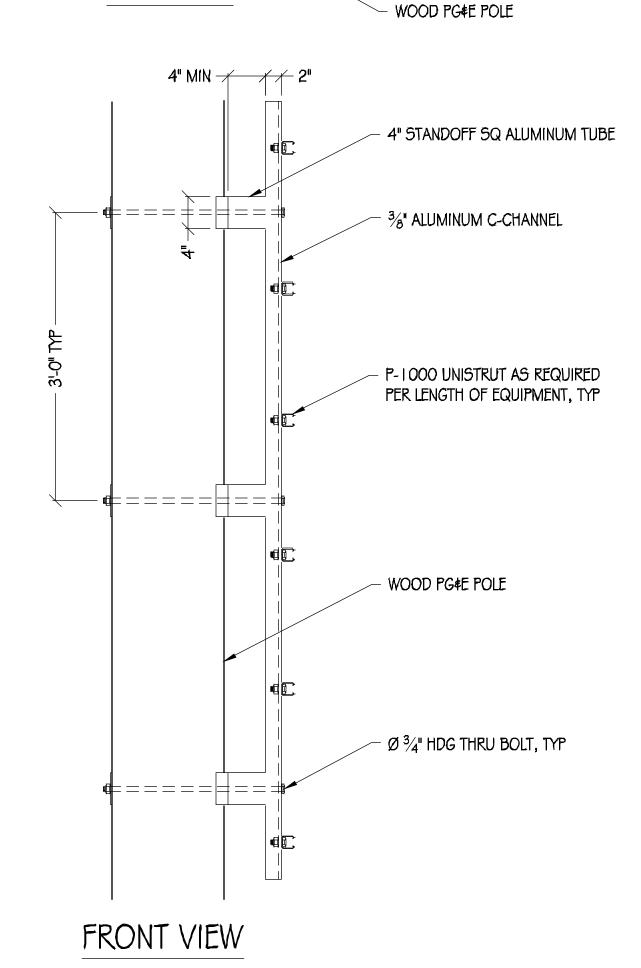

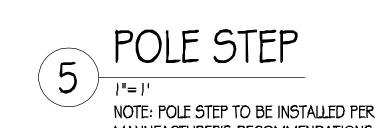

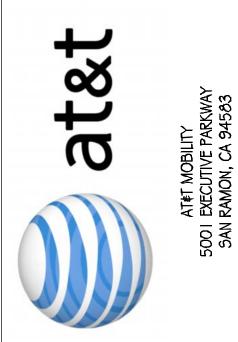





CRAN RSFR LOSAO 12

356 BLUE OAK LN LOS ALTOS, CA 94022

ISSUE STATUS DATE DESCRIPTION 06/19/18 CD 90% 07/25/19 CD 100% DRAWN BY: Q. REDDISH CHECKED BY: T. DICARLO APPROVED BY: B. McCOMB

DETAILS

SHEET TITLE:

SHEET NUMBER

GENERAL ELECTRICAL NOTES:


- PROVIDE ALL ELECTRICAL WORK & MATERIALS AS SHOWN ON THE DWGS, AS CALLED FOR HEREIN, & AS IS NECESSARY TO FURNISH A COMPLETE INSTALLATION.
- 2. THE INSTALLATION SHALL CONFORM TO THE REQUIREMENTS OF THE CURRENT ADOPTED CALIFORNIA ELECTRICAL CODE, STATE OF CALIFORNIA TITLE24, ALL OTHER APPLICABLE CODES AND ORDINANCES \$ THE REQUIREMENTS OF THE FIRE MARSHALL. ALL EQUIPMENT \$ WIRING SHALL BEAR THE APPROVAL STAMP OF UNDERWRITERS LABORATORY (UL) OR AN APPROVED TESTING LABORATORY, PAYMENT FOR ALL INSPECTION FEES AND PERMITS ARE PART OF THIS CONTRACT,
- 3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY AND GOOD CONDITION OF ALL MATERIALS \$ EQUIPMENT FOR THE ENTIRE INSTALLATION \$ UNIT COMPLETION OF WORK, ERECT & MAINTAIN APPROVED & SUITABLE BARRIERS, PROTECTIVE DEVICES & WARNING SIGNS, BE FULLY RESPONSIBLE FOR ANY LOSS OR INJURY TO PERSONS OR PROPERTY RESULTING FROM NEGLIGENCE AND/OR ENFORCEMENT OF ALL SAFETY PRECAUTIONS & WARNINGS.
- 4. COORDINATE THE ELECTRICAL INSTALLATION WITH ALL OTHER TRADES.
- 5. ALL SAW CUTTING, TRENCHING, BACK FILLING & PATCHING SHALL BE RESTORED PER CITY STANDARD DETAILS.
- FINALIZE ALL ELECTRICAL SERVICE ARRANGEMENTS, INCLUDING VERIFICATION OF LOCATIONS, DETAILS, COORDINATION OF THE INSTALLATION & PAYMENT OF ACCRUED CHARGES WITH LOCAL POWER COMPANY, VERIFY LOCATION FOR FACILITIES & DETAILS WITH POWER UTILITY, IN ADDITION TO THE REQUIREMENTS SHOWN IN THE CONTRACT DOCUMENTS, WORK SHALL COMPLY WITH CONSTRUCTION STANDARDS & SERVICE REQUIREMENTS OF THE RESPECTIVE UTILITIES, INCLUDING ANY SUPPLEMENTAL DWGS ISSUED \$ SHALL BE SUBJECT TO APPROVAL OF THESE UTILITIES.
- ALL WIRING SHALL BE COPPER. INSULATION FOR BRANCH CIRCUIT CONDUCTORS SHALL BE TYPE "THWN" CONDUCTORS LARGER AND #6 AWG MAY BE TYPE "THWN" OR "TWN".
- PROVIDE CONDUIT SEALS FOR ALL CONDUITS PENETRATING WEATHERPROOFING OR WEATHERPROOF ENCLOSURE ENVELOPE. MASTIC SEAL ALL CONDUIT OPENING PENETRATIONS COMPLETELY WATERTIGHT.
- 9. UNLESS SHOWN OTHERWISE, FUSED DISCONNECT SWITCHES SHALL BE PROVIDED WITH LOW-PEAK, SYDUAL ELEMENT FUSES SIZED TO EQUIPMENT NAMEPLATE FUSE CURRENT RATING. MOTOR STARTERS SHALL BE PROVIDED WITH SIMILARLY SIZED FUSIBLE ELEMENTS, SWITCHES AND OTHER OUTDOOR EQUIPMENT SHALL BE RATED NEMA 3R AND/OR UL LISTED FOR WET ENVIRONMENT.
- 10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR TESTING THE GROUNDING SYSTEM AND ENSURING A 5 OHM OR LESS GROUNDING PATH, ADDITIONAL GROUND RODS AND/OR CHEMICAL ROD SYSTEM SHALL BE USED TO ACHIEVE THIS REQUIREMENT IF THE GIVEN DESIGN CANNOT BE MADE TO ACHIEVE THIS REQUIREMENT.


POWER AND TELCO NOTES:


- POWER AND TELCO POINTS OF CONNECTION AND ANY EASEMENTS ARE PRELIMINARY AND SUBJECT TO CHANGE BY THE UTILITY COMPANIES.
- CONTRACTOR SHALL COORDINATE WITH UTILITY COMPANY FOR FINAL AND EXACT WORK/MATERIALS REQUIREMENTS AND CONSTRUCT TO UTILITY ENGINEERING PLANS AND SPECIFICATIONS ONLY WHERE APPLICABLE PER PROJECT SCOPE OF WORK.
- 3. CONTRACTOR SHALL FURNISH AND INSTALL CONDUIT, PULL WIRES, CABLE PULL BOXES, CONCRETE ENCASEMENT OF CONDUIT, TRANSFORMER PAD, BARRIERS, POLE RISER TRENCHING, BACK FILL, AND UTILITY FEES, AND INCLUDE REQUIREMENTS IN SCOPE.
- 4. CONTRACTOR SHALL LABEL ALL MAIN DISCONNECT SWITCHES AS REQUIRED BY CODE.
- CONTRACTOR SHALL PROVIDE METER WITH DIST. PANEL AND BREAKERS FOR POWER TO THE BTS UNITS AND THE BTS/ UTILITY CABINET.
- 6. ALL SERVICE EQUIPMENT AND INSTALLATIONS SHALL COMPLY WITH THE N.E.C. AND UTILITY COMPANY AND LOCAL CODE REQUIREMENTS.
- CONTRACTOR SHALL PROVIDE ELECTRICAL SERVICE ENTRANCE EQUIPMENT WITH FAULT CURRENT RATINGS GREATER THAN THE AVAILABLE FAULT CURRENT FROM THE POWER UTILITY.

SINGLE-LINE DIAGRAM

- FIELD ROUTE CONDUIT TO CABINETS AS REQUIRED.

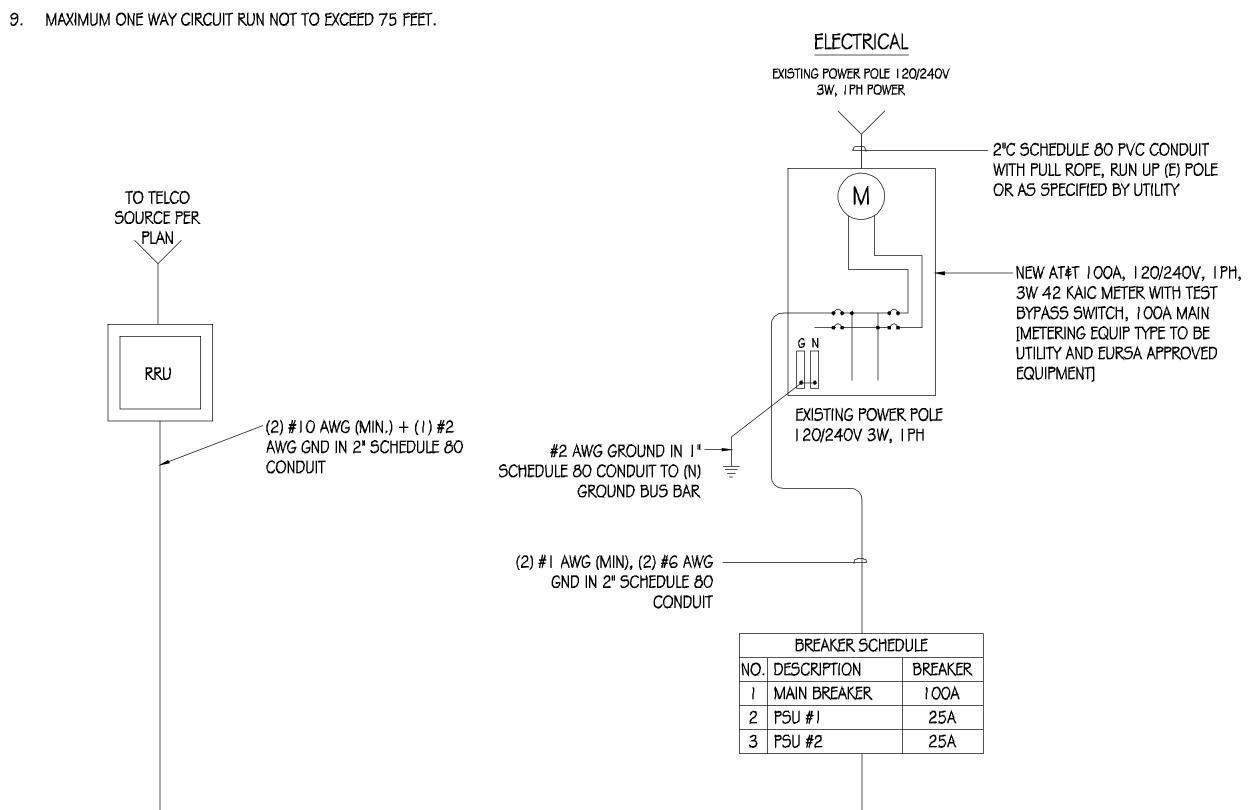

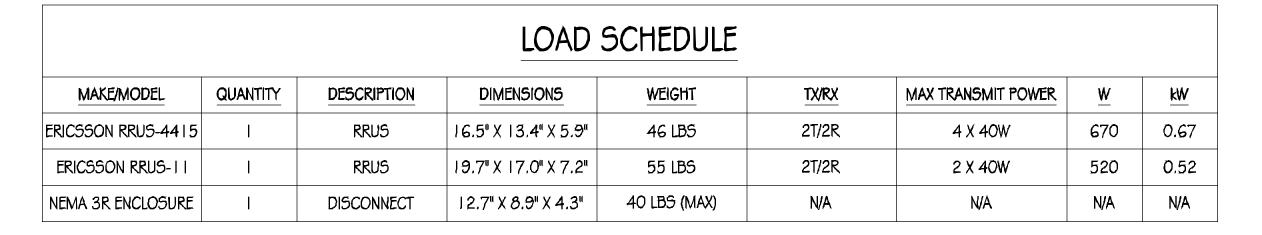


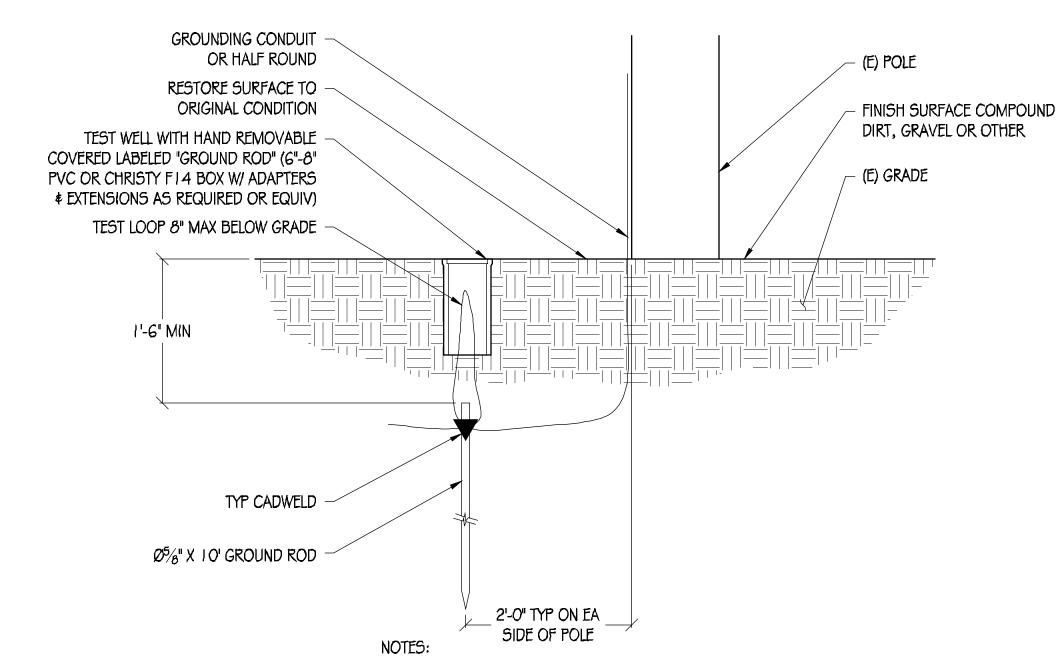


I. REMOVE & REPLACE SIDEWALK SECTION, RESTORATION TO MEET CITY STANDARD DETAILS

2. EXPOSED CONCRETE TO HAVE BROOM FINISH


POLE GROUNDING DETAIL

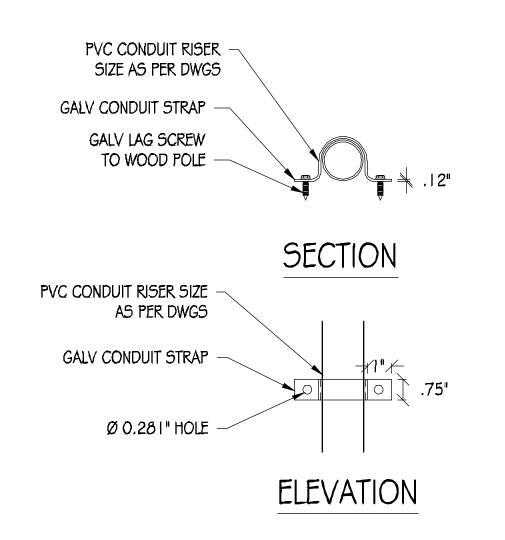

CONDUIT RISER DETAIL

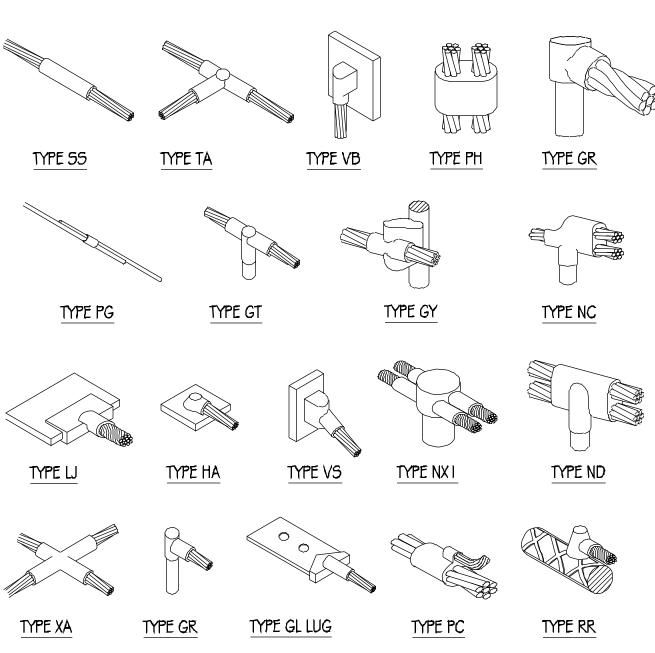


EXOTHERMIC WELD DETAILS

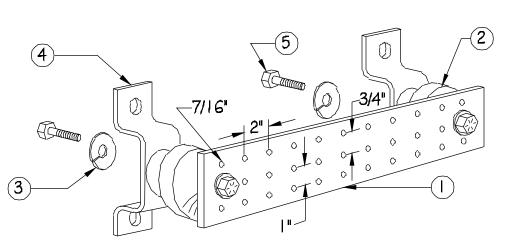

NOTES:

- GALVANIZED STEEL GROUND BAR, HOLE CENTERS TO MATCH NEMA DOUBLE LUG CONFIGURATION. (ACTUAL GROUND BAR SIZE WILL VARY BASED ON NUMBER OF **GROUND CONNECTIONS)**
- INSULATORS, NEWTON INSTRUMENT CAT. NO. 3061-4 OR APPROVED EQUAL
- 5/8" LOCK WASHERS, NEWTON INSTRUMENT CO., CAT. NO. 3015-8 OR APPROVED EQUAL
- WALL MOUNTING BRACKET, NEWTON INSTRUMENT CO., CAT NO. A-6056 OR APPROVED EQUAL
- 5/8-11 X I" HHCS BOLTS, NEWTON INSTRUMENT CO., CAT NO. 3012-1 OR APPROVED EQUAL
- INSULATORS SHALL BE ELIMINATED WHEN BONDING DIRECTLY TO TOWER/MONOPINE STRUCTURE. CONNECTION TO TOWER/MONOPINE STRUCTURE SHALL BE PER MANUFACTURERS RECOMMENDATIONS.



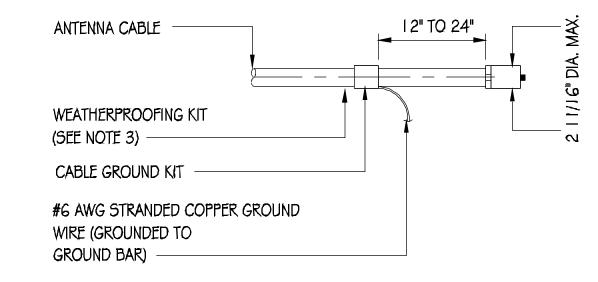


NOTES:

- I. DO NOT INSTALL CABLE GROUND KIT AT A BEND AND ALWAYS DIRECT GROUND WIRE DOWN TO GROUND BAR.
- 2. GROUNDING KIT SHALL BE TYPE AND PART NUMBER AS SUPPLIED OR RECOMMENDED BY CABLE MANUFACTURER.
- 3. WEATHER PROOFING SHALL BE (TYPE AND PART NUMBER AS SUPPLIED OR RECOMMENDED BY CABLE MANUFACTURER.)









CRAN RSFR LOSAO 12

356 BLUE OAK LN LO5 ALTO5, CA 94022


ISSUE STATUS DESCRIPTION CD 90% 06/19/18 CD 100% 07/25/19 DRAWN BY: Q. REDDISH CHECKED BY: T. DICARLO APPROVED BY: B. McCOMB DATE: 07/25/19

SINGLE-LINE DIAGRAM \$ DETAILS


SHEET TITLE:


SHEET NUMBER

_

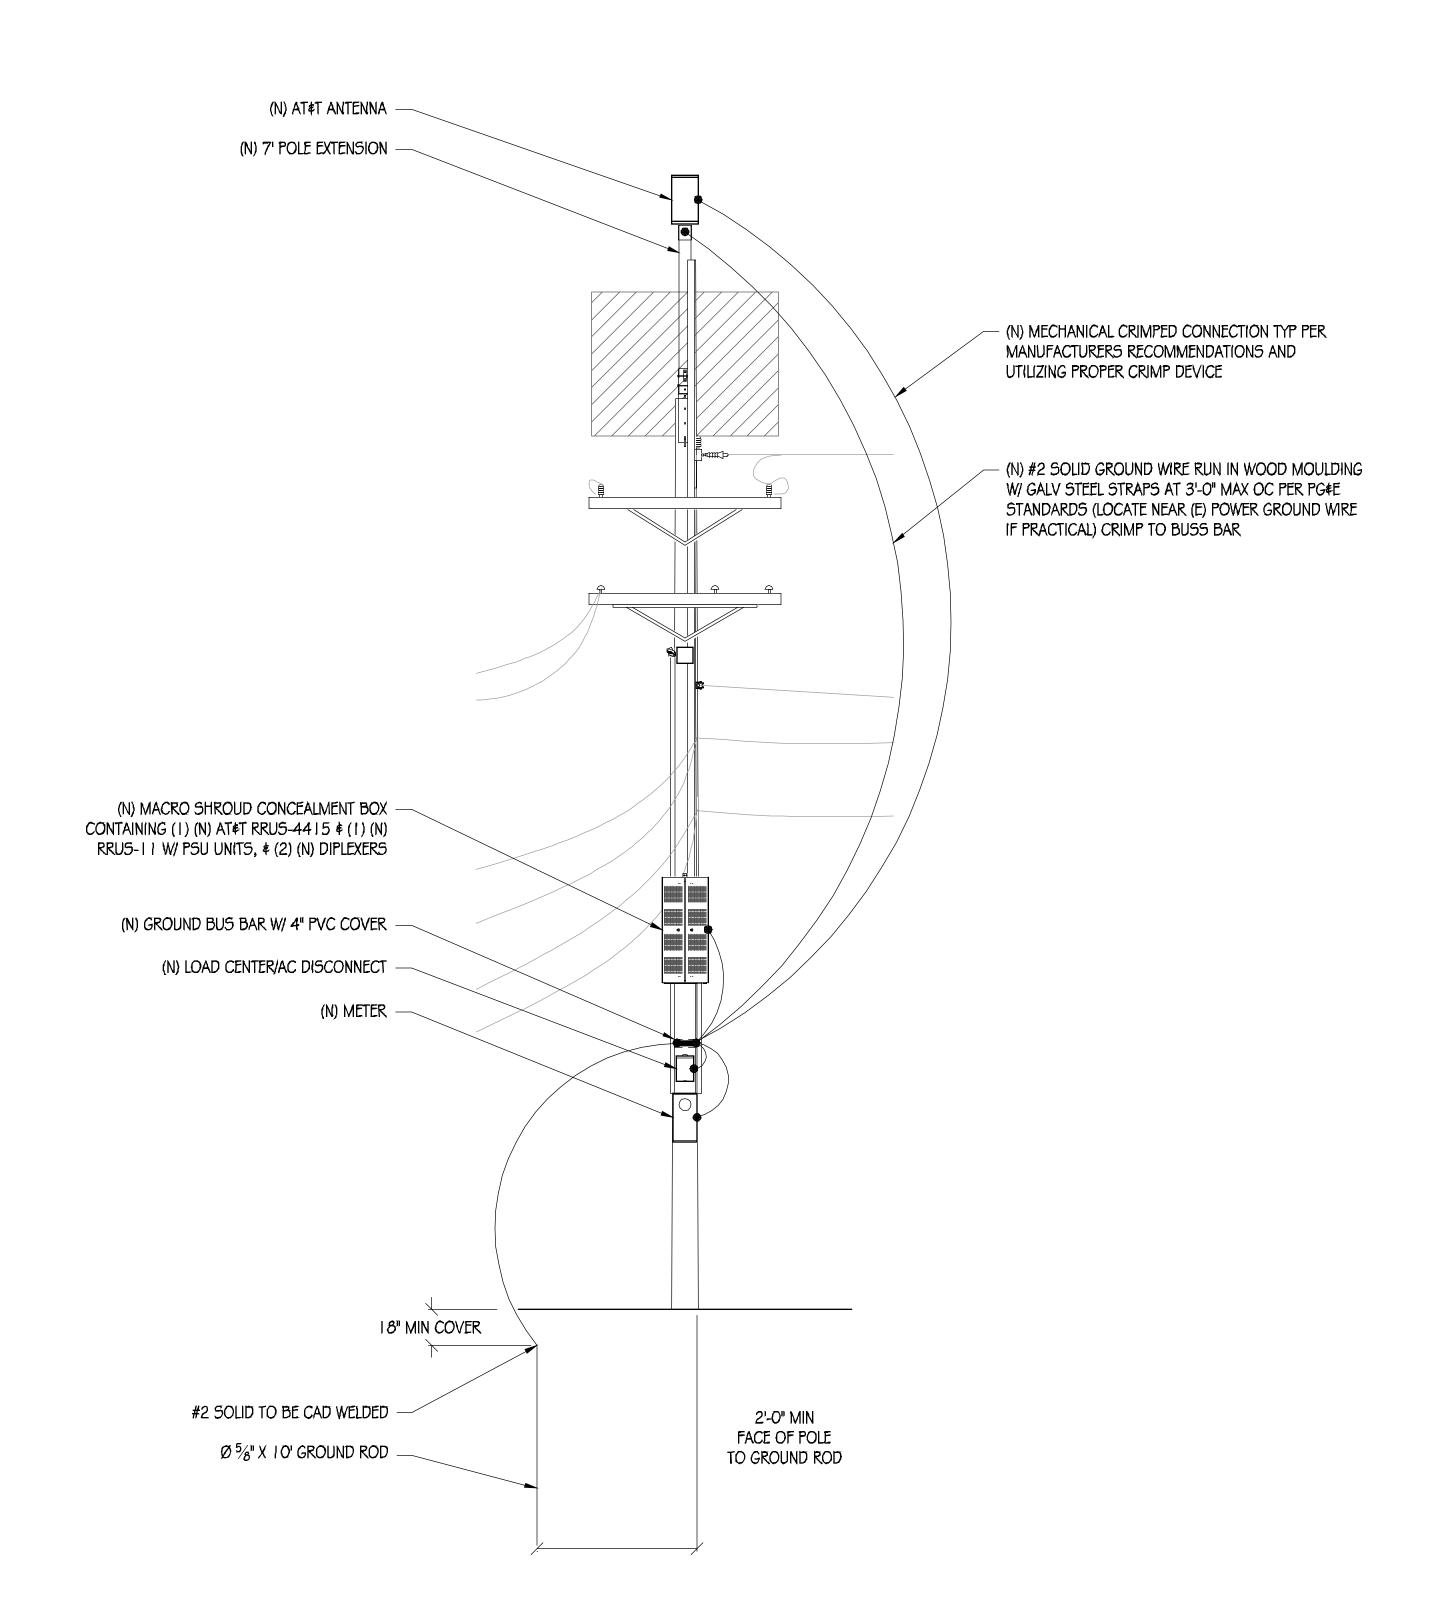

POLE GROUNDING DIAGRAM

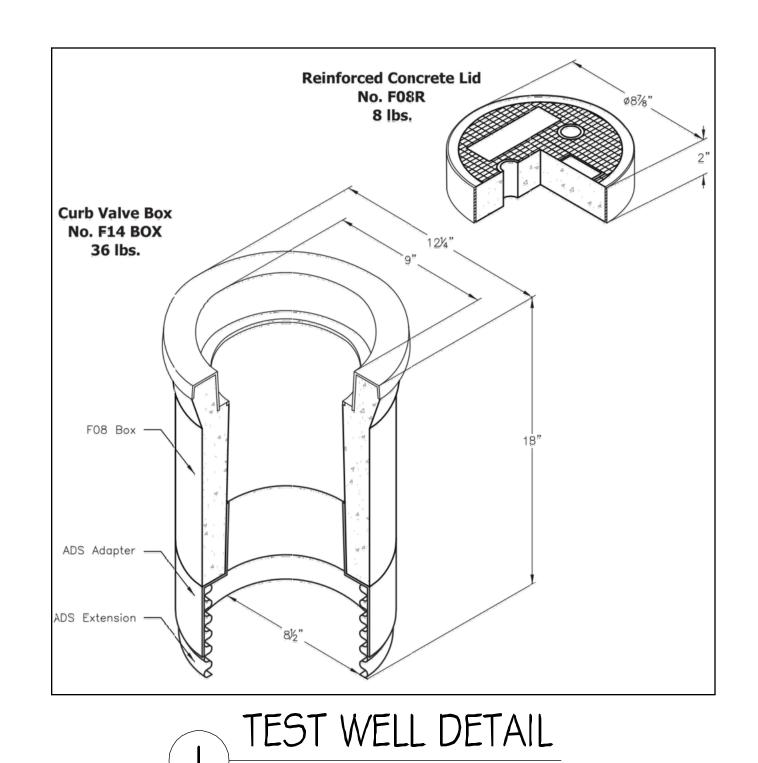

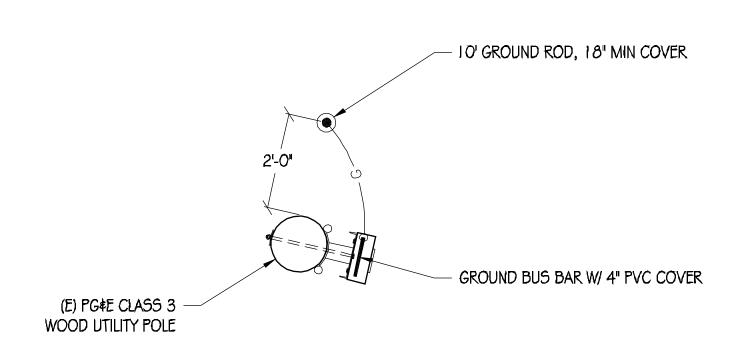









CRAN_RSFR_LOSAO_12

356 BLUE OAK LN LOS ALTOS, CA 94022

	STATUS			
\triangle	DATE	DESCRIPTION		
	06/19/18	CD 90%		
	07/25/19	CD 100%		
DRAWN	l BY:	O. REDDISH		
CHECKED BY:		T. DICARLO		
APPROVED BY:		В. МсСОМВ		
DATE:	-	07/25/1 <i>9</i>		

GROUNDING DIAGRAMS

SHEET TITLE:

SHEET NUMBER

F-2