



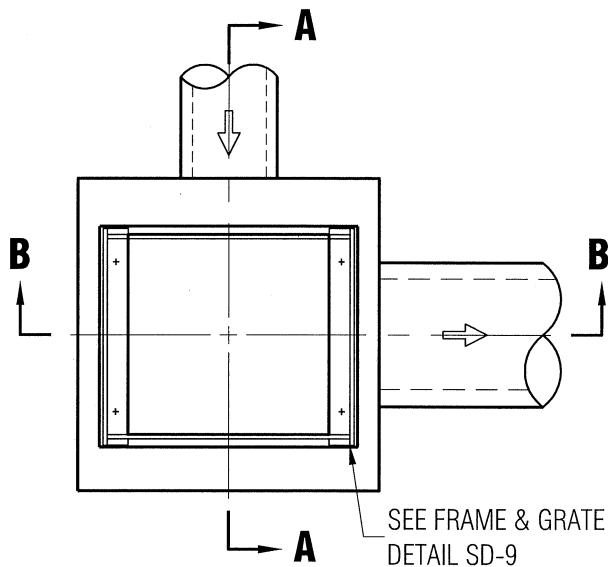


PLAN

NOTE:

1. OUTLET PIPE SHALL BE MIN. 12" - MAX. 18" DIAMETER.
2. ALL CONCRETE SHALL BE CLASS "A", 3/4" MAX. AGGREGATE, 3,300 PSI.
3. THE CROWN OF THE INLET PIPE SHALL BE SET AT THE SAME ELEVATION OF THE CROWN OF THE OUTLET PIPE.
4. REINFORCING STEEL SHALL BE REQUIRED FOR WALLS GREATER THAN 6' IN DEPTH. BOTTOM REBAR MAT IS REQUIRED REGARDLESS OF HEIGHT OF WALLS.
5. CHRISTY U23 CATCH BASIN (2' x 2' WITH 6" WALLS) OR AN APPROVED EQUAL.
6. SEE NOTES ON SD-6.

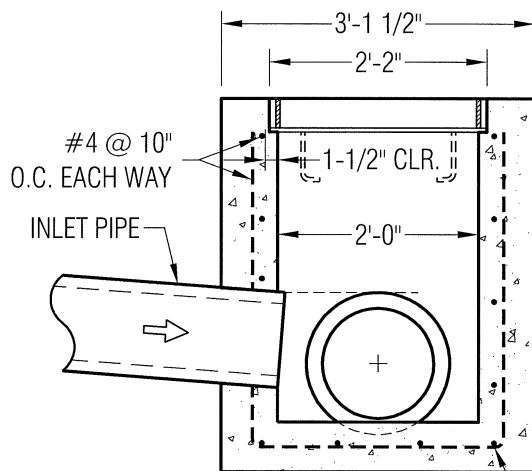


SECTION A-A

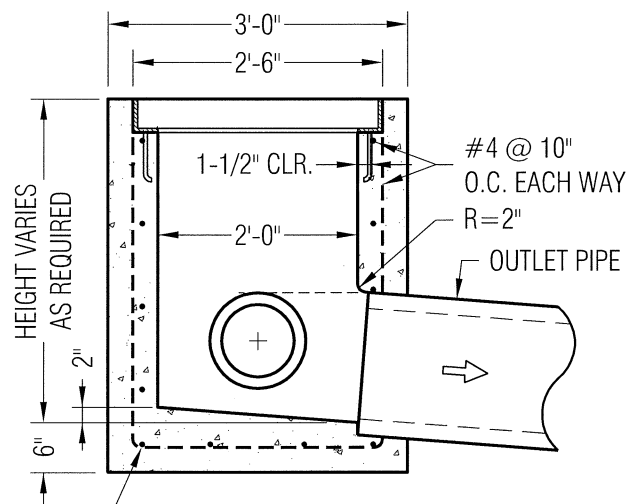

SECTION B-B

4-#4 EVENLY SPACED
SEE NOTE 4

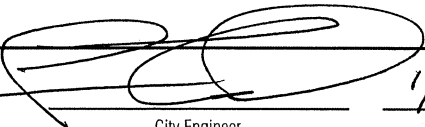Approved:  1/4/10
City Engineer Date



REVISION

Description	Date

ENGINEERING DIVISION

**2' X 2'
STORM DRAIN
INLET**

SD-8