
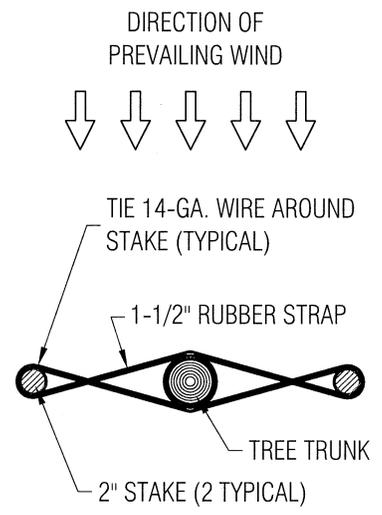


X: DIAMETER OF ROOT BALL
 Y: HEIGHT OF ROOT BALL

- NOTES:**
1. FOR TREES PLANTED WITHIN 6' OF A PERMANENT STRUCTURE (DRIVEWAY, SIDEWALK, CURB, ETC.) INSTALL A "DEEP ROOT BARRIER PLANTER NO. RB12-2 MANUFACTURED BY DEEP ROOT CORP." OR APPROVED EQUAL
 2. FOR TREE PLANTED IN A NON-IRRIGATED AREA OR WHERE HAND WATERING IS NECESSARY, INSTALL AT THE PERIMETER A 4"x30" P.V.C. DRAIN PIPE WITH A 4" SLOAN GRATE OR APPROVED EQUAL 1" ABOVE FINISH GRADE
 3. TREES SHALL BE PLANTED A MINIMUM OF 10' FROM SANITARY SEWER LATERALS AND 5' FROM WATER SERVICES AND DRIVEWAYS

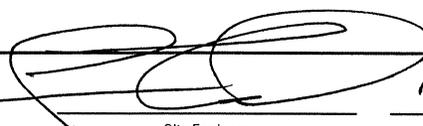

PLAN

Approved:  1/4/10
 City Engineer Date



REVISION	
Description	Date

ENGINEERING DIVISION	
TREE PLANTING AND STAKING	LI-1